

PROPRIETARY INFORMATION: THIS DRAWING IS THE PROPERTY OF AMEC ENVIRONMENT & INFRASTRUCTURE AND IS NOT TO BE LOANED OR REPRODUCED IN ANY WAY WITHOUT THE PERMISSION OF AMEC ENVIRONMENT & INFRASTRUCTURE

KNIGHT STREET SOLAR


998.40 KW DC GROUND-MOUNT SOLAR PV DEVELOPMENT

275 KNIGHT STREET


WARWICK, RHODE ISLAND

LAST ISSUED ON FEBRUARY 09, 2023

ISSUED FOR PERMITTING / NOT FOR CONSTRUCTION

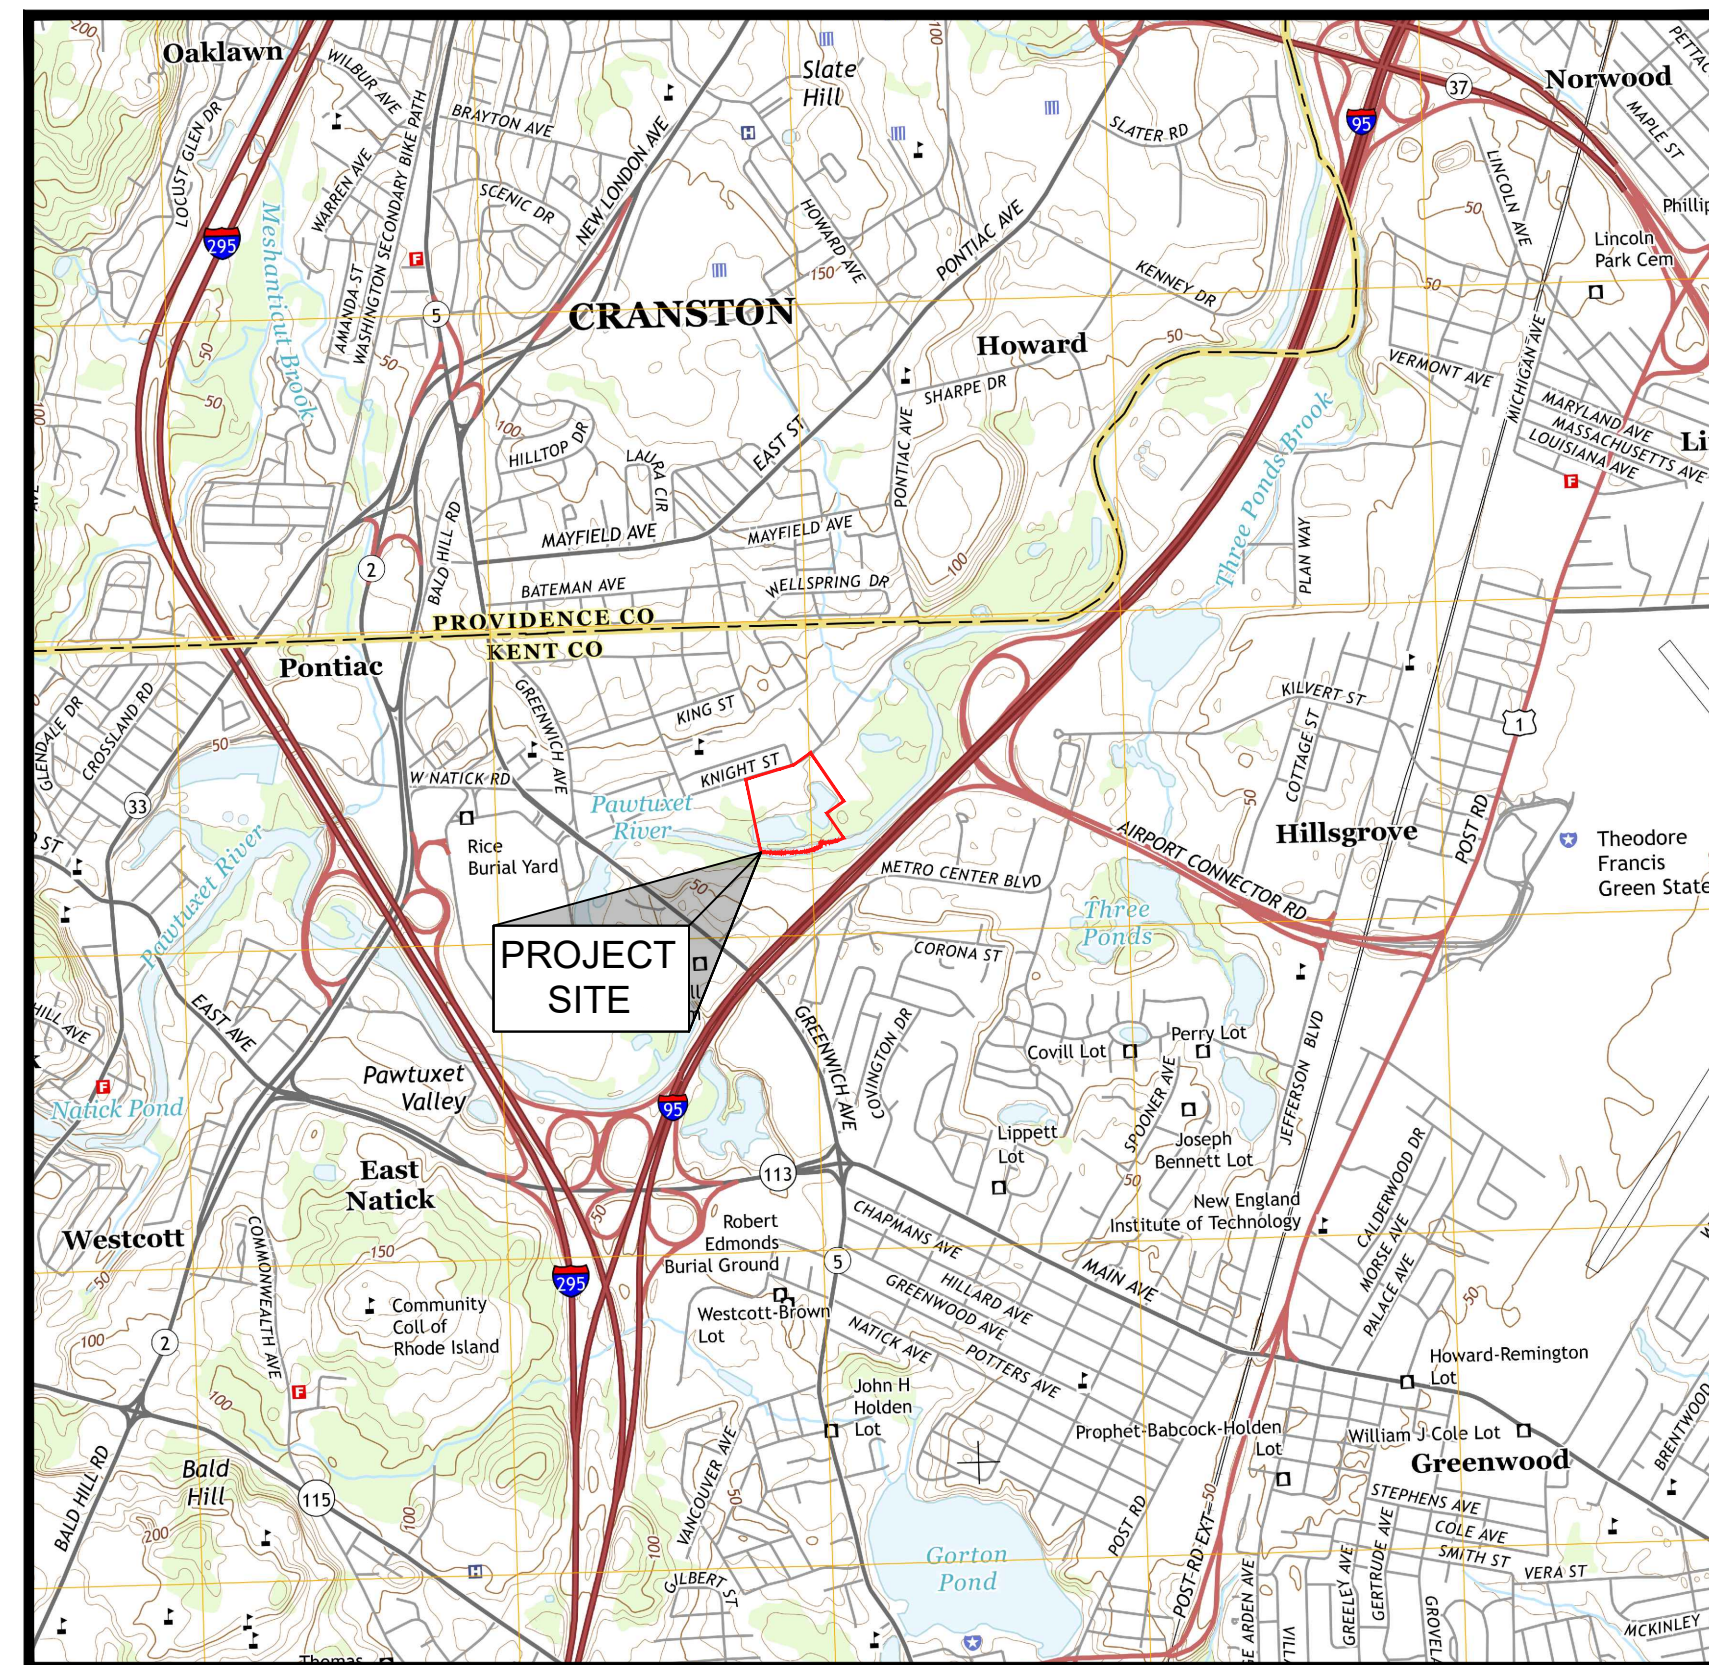

LOCUS MAP
1" = 2000'

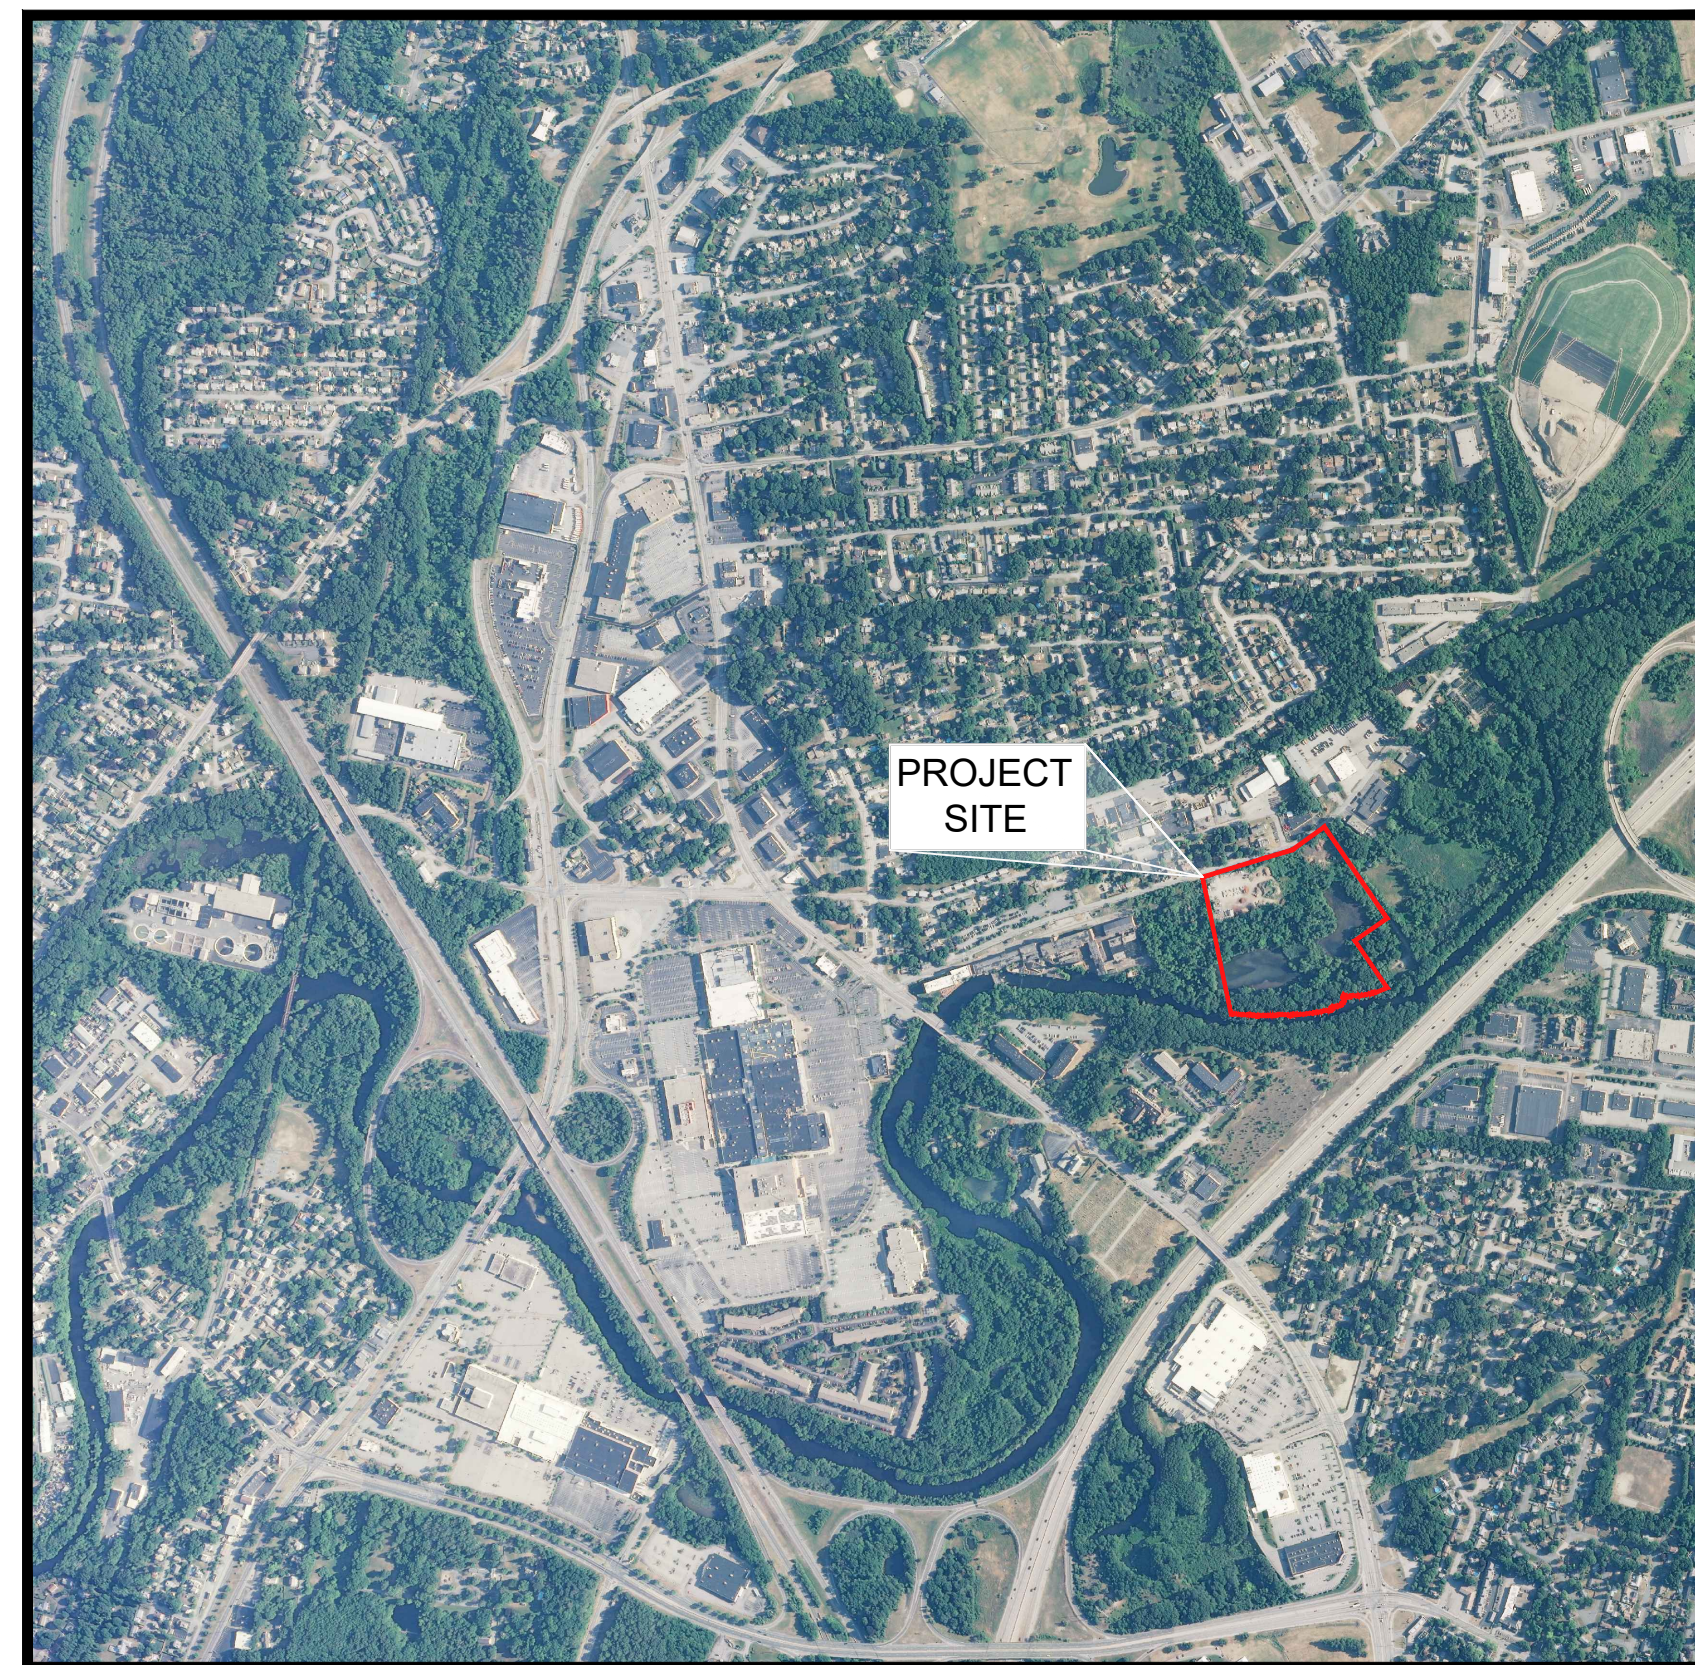

AERIAL IMAGE
NOT TO SCALE

DRAWING INDEX

SHEET NUMBER	DRAWING TITLE	DRAWING NUMBER
	COVER SHEET	
1	EXISTING CONDITIONS PLAN	V-101
2	POST-TENANT EXISTING CONDITIONS PLAN	V-102
3	PROPOSED SITE PLAN	C-101
4	CONSTRUCTION, EROSION, AND SEDIMENTATION CONTROL DETAILS AND NOTES	C-501
5	CONSTRUCTION, EROSION, AND SEDIMENTATION CONTROL DETAILS	C-502
-	BOUNDARY & TOPOGRAPHIC SURVEY, PLAT 275 LOTS 38 & 52, KNIGHT STREET, WARWICK, RHODE ISLAND	N/A

PROPERTY OWNER

SUNSHINE PROPERTIES, LLC
181 KNIGHT ST.
WARWICK, RHODE ISLAND 02886

DEVELOPED BY

VCP, LLC

VEROGY


150 TRUMBULL ST.
HARTFORD, CONNECTICUT 06103

PREPARED BY



WSP USA ENVIRONMENT & INFRASTRUCTURE, INC.
275 PROMENADE STREET
PROVIDENCE, RHODE ISLAND 02908

W:\FD\FS3\Projects\old_WFD-FS3_Data\Departments_CAD\Projects\Verogy\Knight Street\7.0_CAD\7.1_Design_Permittin\Sheets\0 - 365220259 - C-000.dwg - Layout1 - Feb. 09, 2023 11:13am - peter.galland

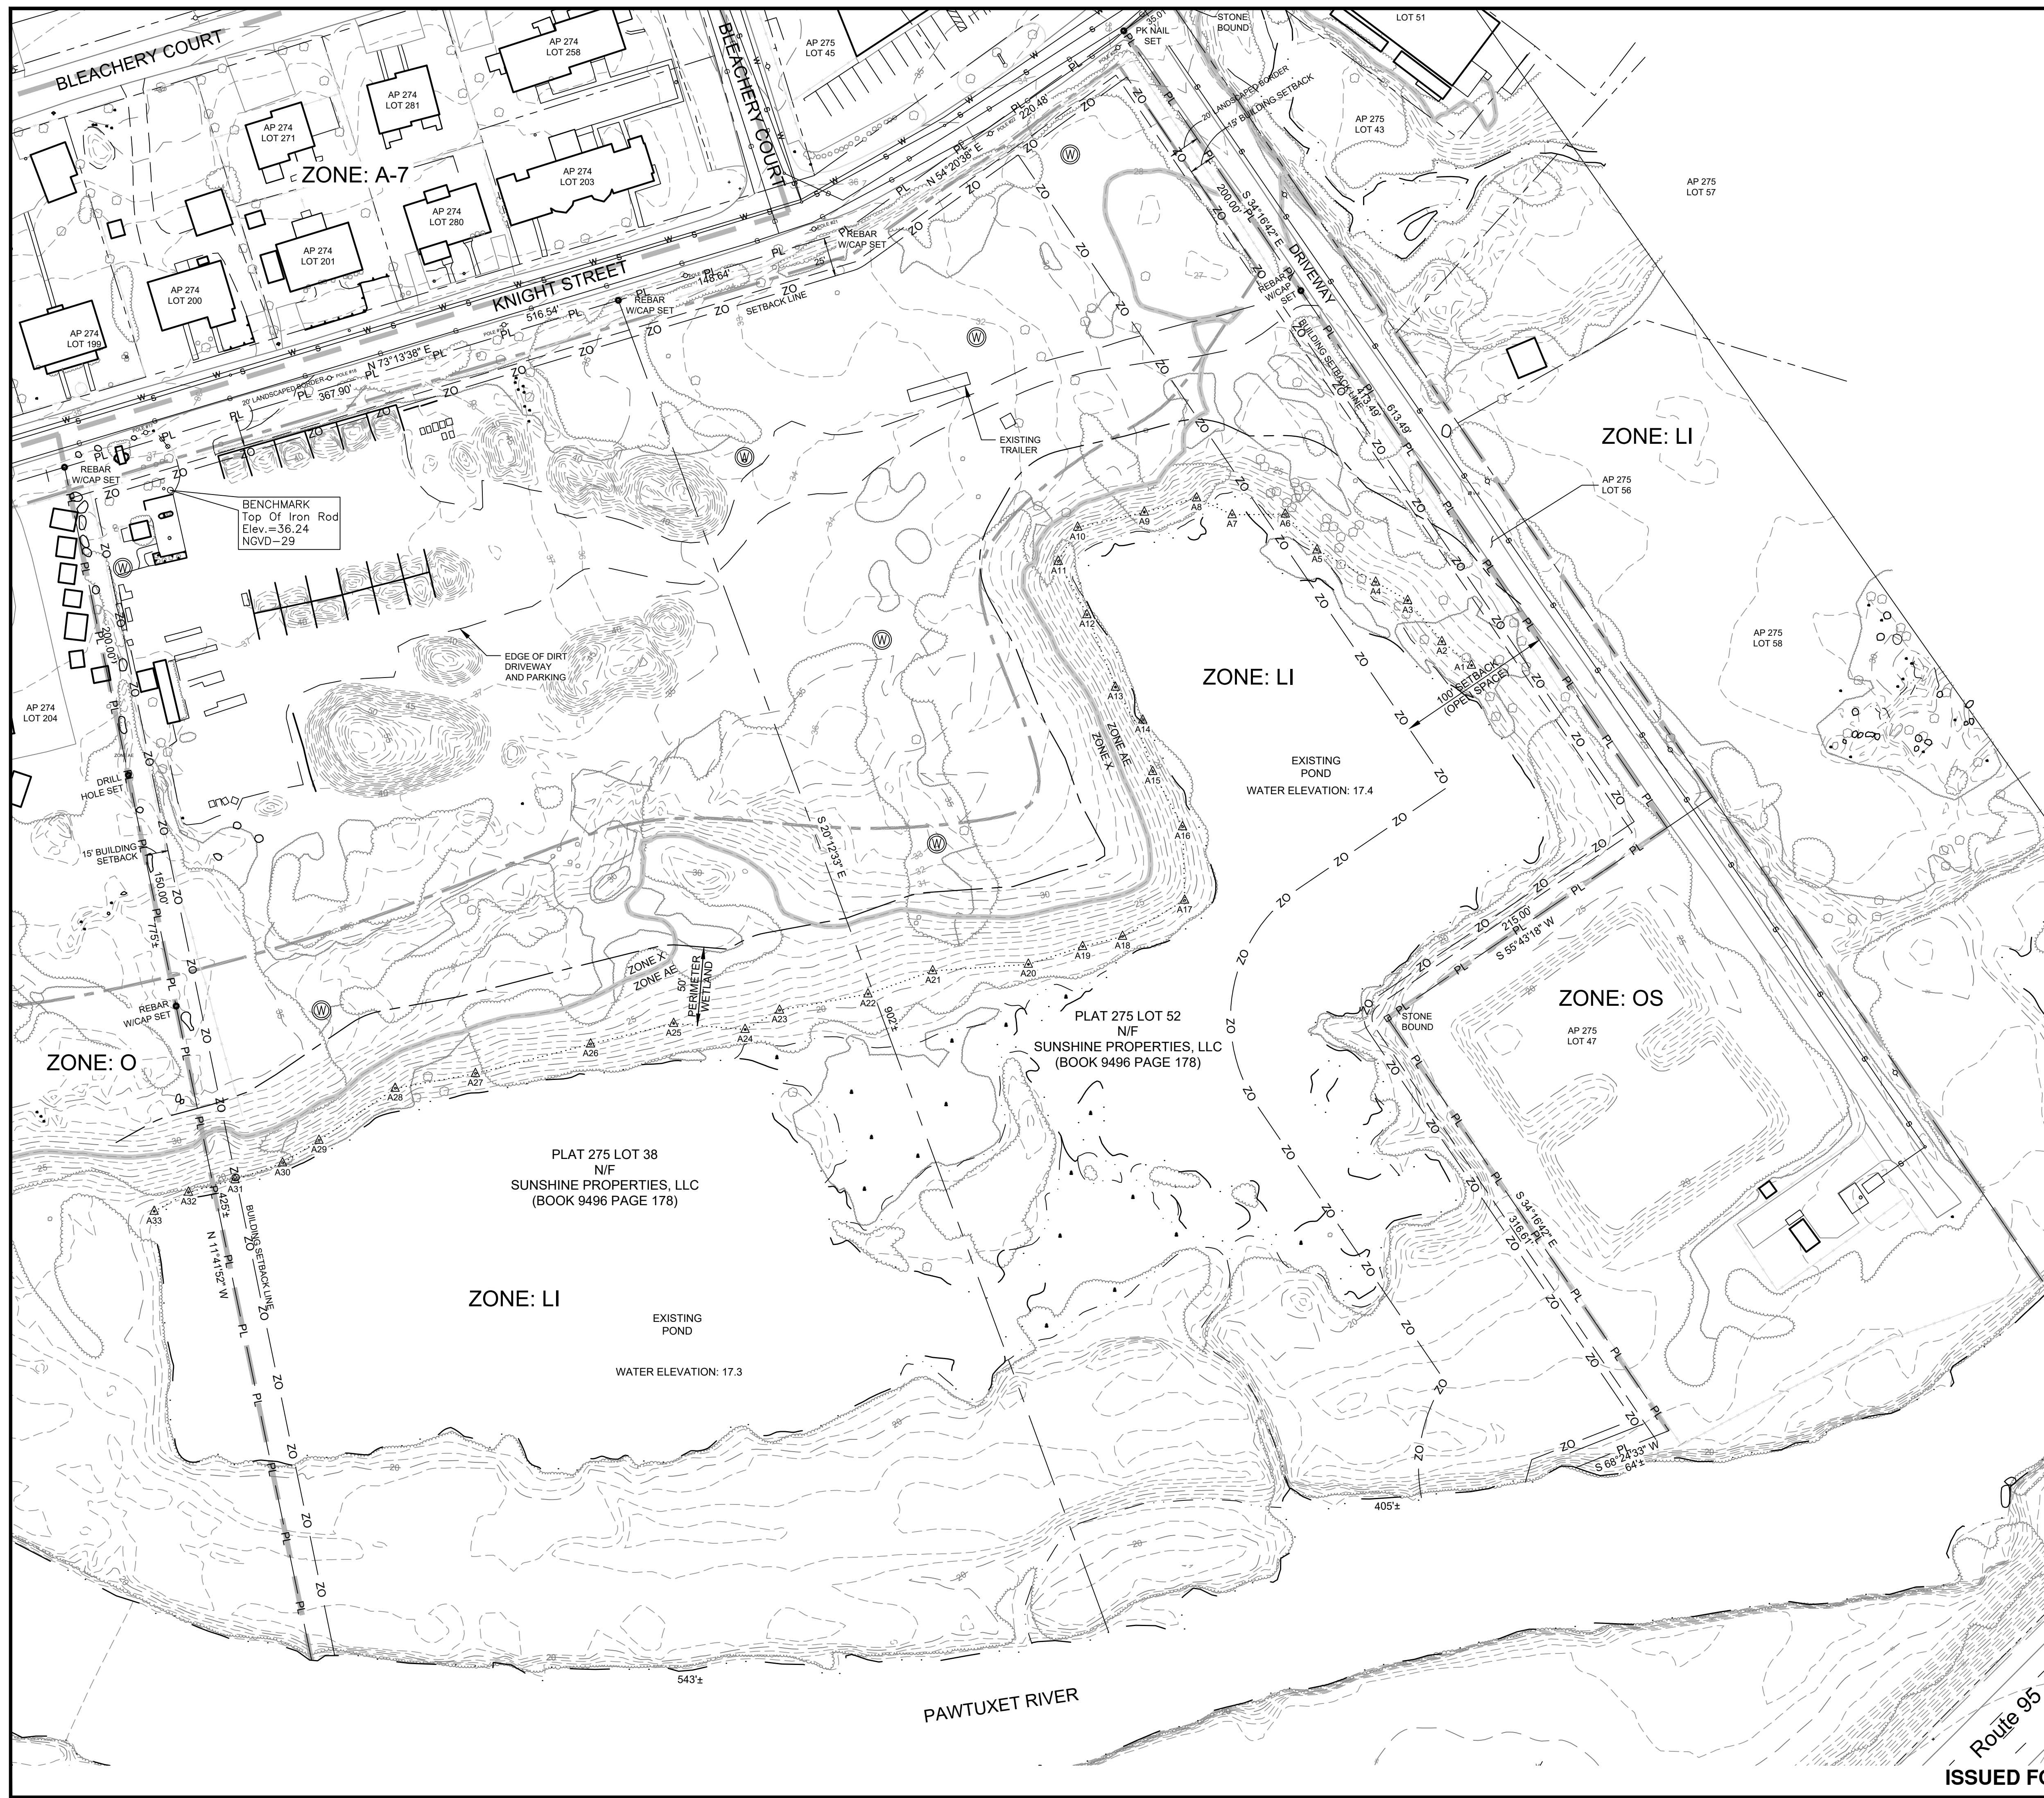

- GENERAL NOTES:**
- RECORD OWNER OF THE PROPERTY: SUNSHINE PROPERTIES, LLC AS SHOWN ON THE CITY OF WARWICK PLAT 275, PARCELS 38 & 52. FOR FURTHER REFERENCES SEE DEED BOOK 9496, PAGE 178.
 - HORIZONTAL DATUM IS BASED ON RHODE ISLAND STATE GRID COORDINATE SYSTEM NAD83 (2011) AND THE VERTICAL DATUM IS REFERENCED TO NAVD 29.
 - WETLANDS SHOWN ON THIS PLAN WERE DELINEATED BY OTHERS. WETLAND FLAGS WERE LOCATED ON 2/4/2021 BY NATURAL RESOURCE SERVICES, INC., OF HARRISVILLE, RHODE ISLAND.
 - FLOOD ZONE INFORMATION FROM FIRM FLOOD INSURANCE RATE MAP CITY OF WARWICK, RHODE ISLAND, KENT COUNTY, PANEL 2 OF 9, COMMUNITY - PANEL NUMBER 445409 0002 D, MAP REVISED APRIL 16, 1991.
 - FLOOD ZONE AREA WAS REVISED FOR LOCUS PARCEL PER: FEDERAL EMERGENCY MANAGEMENT AGENCY, LETTER OF MAP REVISION FLOODWAY DETERMINATION DOCUMENT (REMOVAL), DATED MARCH 20, 2007, CASE NO. 07-01-0070A (100-YEAR FLOODPLAIN AT ELEVATION 29).
 - WSP USA ENVIRONMENT & INFRASTRUCTURE, INC. HAS NOT INDEPENDENTLY VERIFIED THE LOCATION, EXISTENCE, AND SERVICEABILITY FOR ANY UTILITIES IN THIS VICINITY. WSP ALSO MAKES NO GUARANTEE TO THE COMPLETENESS - MISSING - ACCURACY - DAMAGES INCURRED OF ANY UTILITIES. ACTUAL LOCATIONS MUST BE FIELD DETERMINED PRIOR TO EXCAVATION OR OTHER CONSTRUCTION ACTIVITIES. CALL "DIG SAFE" AT 811.
 - EXISTING CONDITIONS PLAN FROM BOUNDARY & TOPOGRAPHIC SURVEY, PREPARED FOR KNIGHT STREET GROUP, LLC, PLAT 275 LOTS 38 & 52, KNIGHT STREET, WARWICK, RHODE ISLAND, JOB NO. 208064, DATED MARCH 27, 2009, BY CHERENZIA & ASSOCIATES, LTD., OF PAWTUCKET, CONNECTICUT.
 - LANDSCAPE MATERIAL STOCKPILES WILL BE REMOVED WHEN CURRENT TENANT VACATES THE SITE.

EXISTING LEGEND

--- -20---	MAJOR CONTOUR
--- 10---	MINOR CONTOUR
PL PL	SITE PROPERTY LINE
---	PARCEL LINE
---	OFF-SITE PROPERTY LINE
ZO ZO	ZONING SETBACK
---	FENCE LINE
---	SANITARY SEWER UTILITY
---	GAS UTILITY
---	WATER UTILITY
---	STORM DRAIN UTILITY
--- A17 ---	WETLAND LINE WITH FLAG AND ID
---	50' WETLAND BUFFER
---	DIRT DRIVEWAY
---	TREE LINE
---	SCRUB LINE
---	UTILITY POLE
---	MONITORING WELL
---	SHRUBS
---	ROCKS AND BOULDERS
---	PARCEL ID
---	ZONE AE FEMA 100-YR FLOOD LINE WITH ZONE ID (LOCATED AT 29' ELEVATION)
---	ZONE X
---	APPROXIMATE LIMIT OF WASTE
---	ZONE: LI WARWICK ZONING BOUNDARY WITH ID
---	ZONE: OS



REVISION	DATE	ISSUE / REVISION DESCRIPTION
5	2/09/2023	ISSUED FOR PERMITTING / NOT FOR CONSTRUCTION
4	1/19/2023	RESPONSE TO RIBEM COMMENTS
3	9/10/2021	RESPONSE TO RIBEM COMMENTS
2	8/20/2021	ADDRESSED COMMENTS
1	6/28/2021	ISSUED FOR PERMITTING / NOT FOR CONSTRUCTION
0	5/27/2021	ISSUED FOR PERMITTING / NOT FOR CONSTRUCTION

PROJECT: 998.40 KW DC GROUND-MOUNT SOLAR PV DEVELOPMENT
 275 KNIGHT STREET
 WARWICK, RHODE ISLAND

TITLE: EXISTING CONDITIONS PLAN


CLIENT: VCP, LLC
 150 TRUMBULL ST.
 HARTFORD, CT 06103

VEROGEY

SEAL: ANDREW P. VARDAKIS
 No. 12219
 REGISTERED PROFESSIONAL ENGINEER (CIVIL)

DESIGNED BY: CR
 DRAWN BY: BEG
 CHECKED BY: GAA
 SCALE: AS SHOWN

PROJECT NUMBER: 3652200299
 DRAWING NUMBER: V-101
 SHEET NUMBER: 1 OF 5

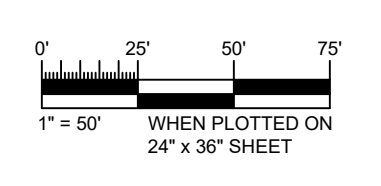

ISSUED FOR PERMITTING / NOT FOR CONSTRUCTION

UNLESS OTHERWISE AGREED IN A WRITTEN CONTRACT BETWEEN WSP USA ENVIRONMENT & INFRASTRUCTURE, INC. AND ITS CLIENT: (I) THIS DOCUMENT CONTAINS INFORMATION, DATA AND DESIGN THAT IS CONFIDENTIAL AND MAY NOT BE COPIED OR DISCLOSED; AND (II) THIS DOCUMENT MAY ONLY BE USED BY THE CLIENT IN THE CONTEXT AND FOR THE EXPRESS PURPOSE FOR WHICH IT HAS BEEN DELIVERED. ANY OTHER USE OR RELIANCE ON THIS DOCUMENT BY ANY THIRD PARTY IS AT THAT PARTY'S SOLE RISK AND RESPONSIBILITY.



WSP USA ENVIRONMENT AND
INFRASTRUCTURE, INC.
100 APOLO DRIVE, SUITE 302
CHELMSFORD, MA 01824
978-692-9090
WSP.COM

REVISION	DATE	ISSUE / REVISION DESCRIPTION
5	2/09/2023	ISSUED FOR PERMITTING / NOT FOR CONSTRUCTION
4	1/19/2023	RESPONSE TO RIEEM COMMENTS
3	9/10/2021	RESPONSE TO RIEEM COMMENTS
2	8/20/2021	RESPONSE TO RIEEM COMMENTS
1	6/28/2021	ADDRESSED COMMENTS
0	5/27/2021	ISSUED FOR PERMITTING / NOT FOR CONSTRUCTION

PROJECT: 998.40 KW DC GROUND-MOUNT
SOLAR PV DEVELOPMENT
275 KNIGHT STREET
WARWICK, RHODE ISLAND

TITLE: POST-TENANT
EXISTING CONDITIONS PLAN


VCP, LLC
150 TRUMBULL ST.
HARTFORD, CT 06103

VEROGEY

CLIENT: ANDREW P. VARDAKIS
No. 12219
REGISTERED
PROFESSIONAL ENGINEER
(CIVIL)

DESIGNED BY: CR
CHECKED BY: GAA
PROJECT NUMBER: 3652200299
DRAWING NUMBER: V-102
SHEET NUMBER: 2 OF 5

DRAWN BY: BEG
SCALE: AS SHOWN

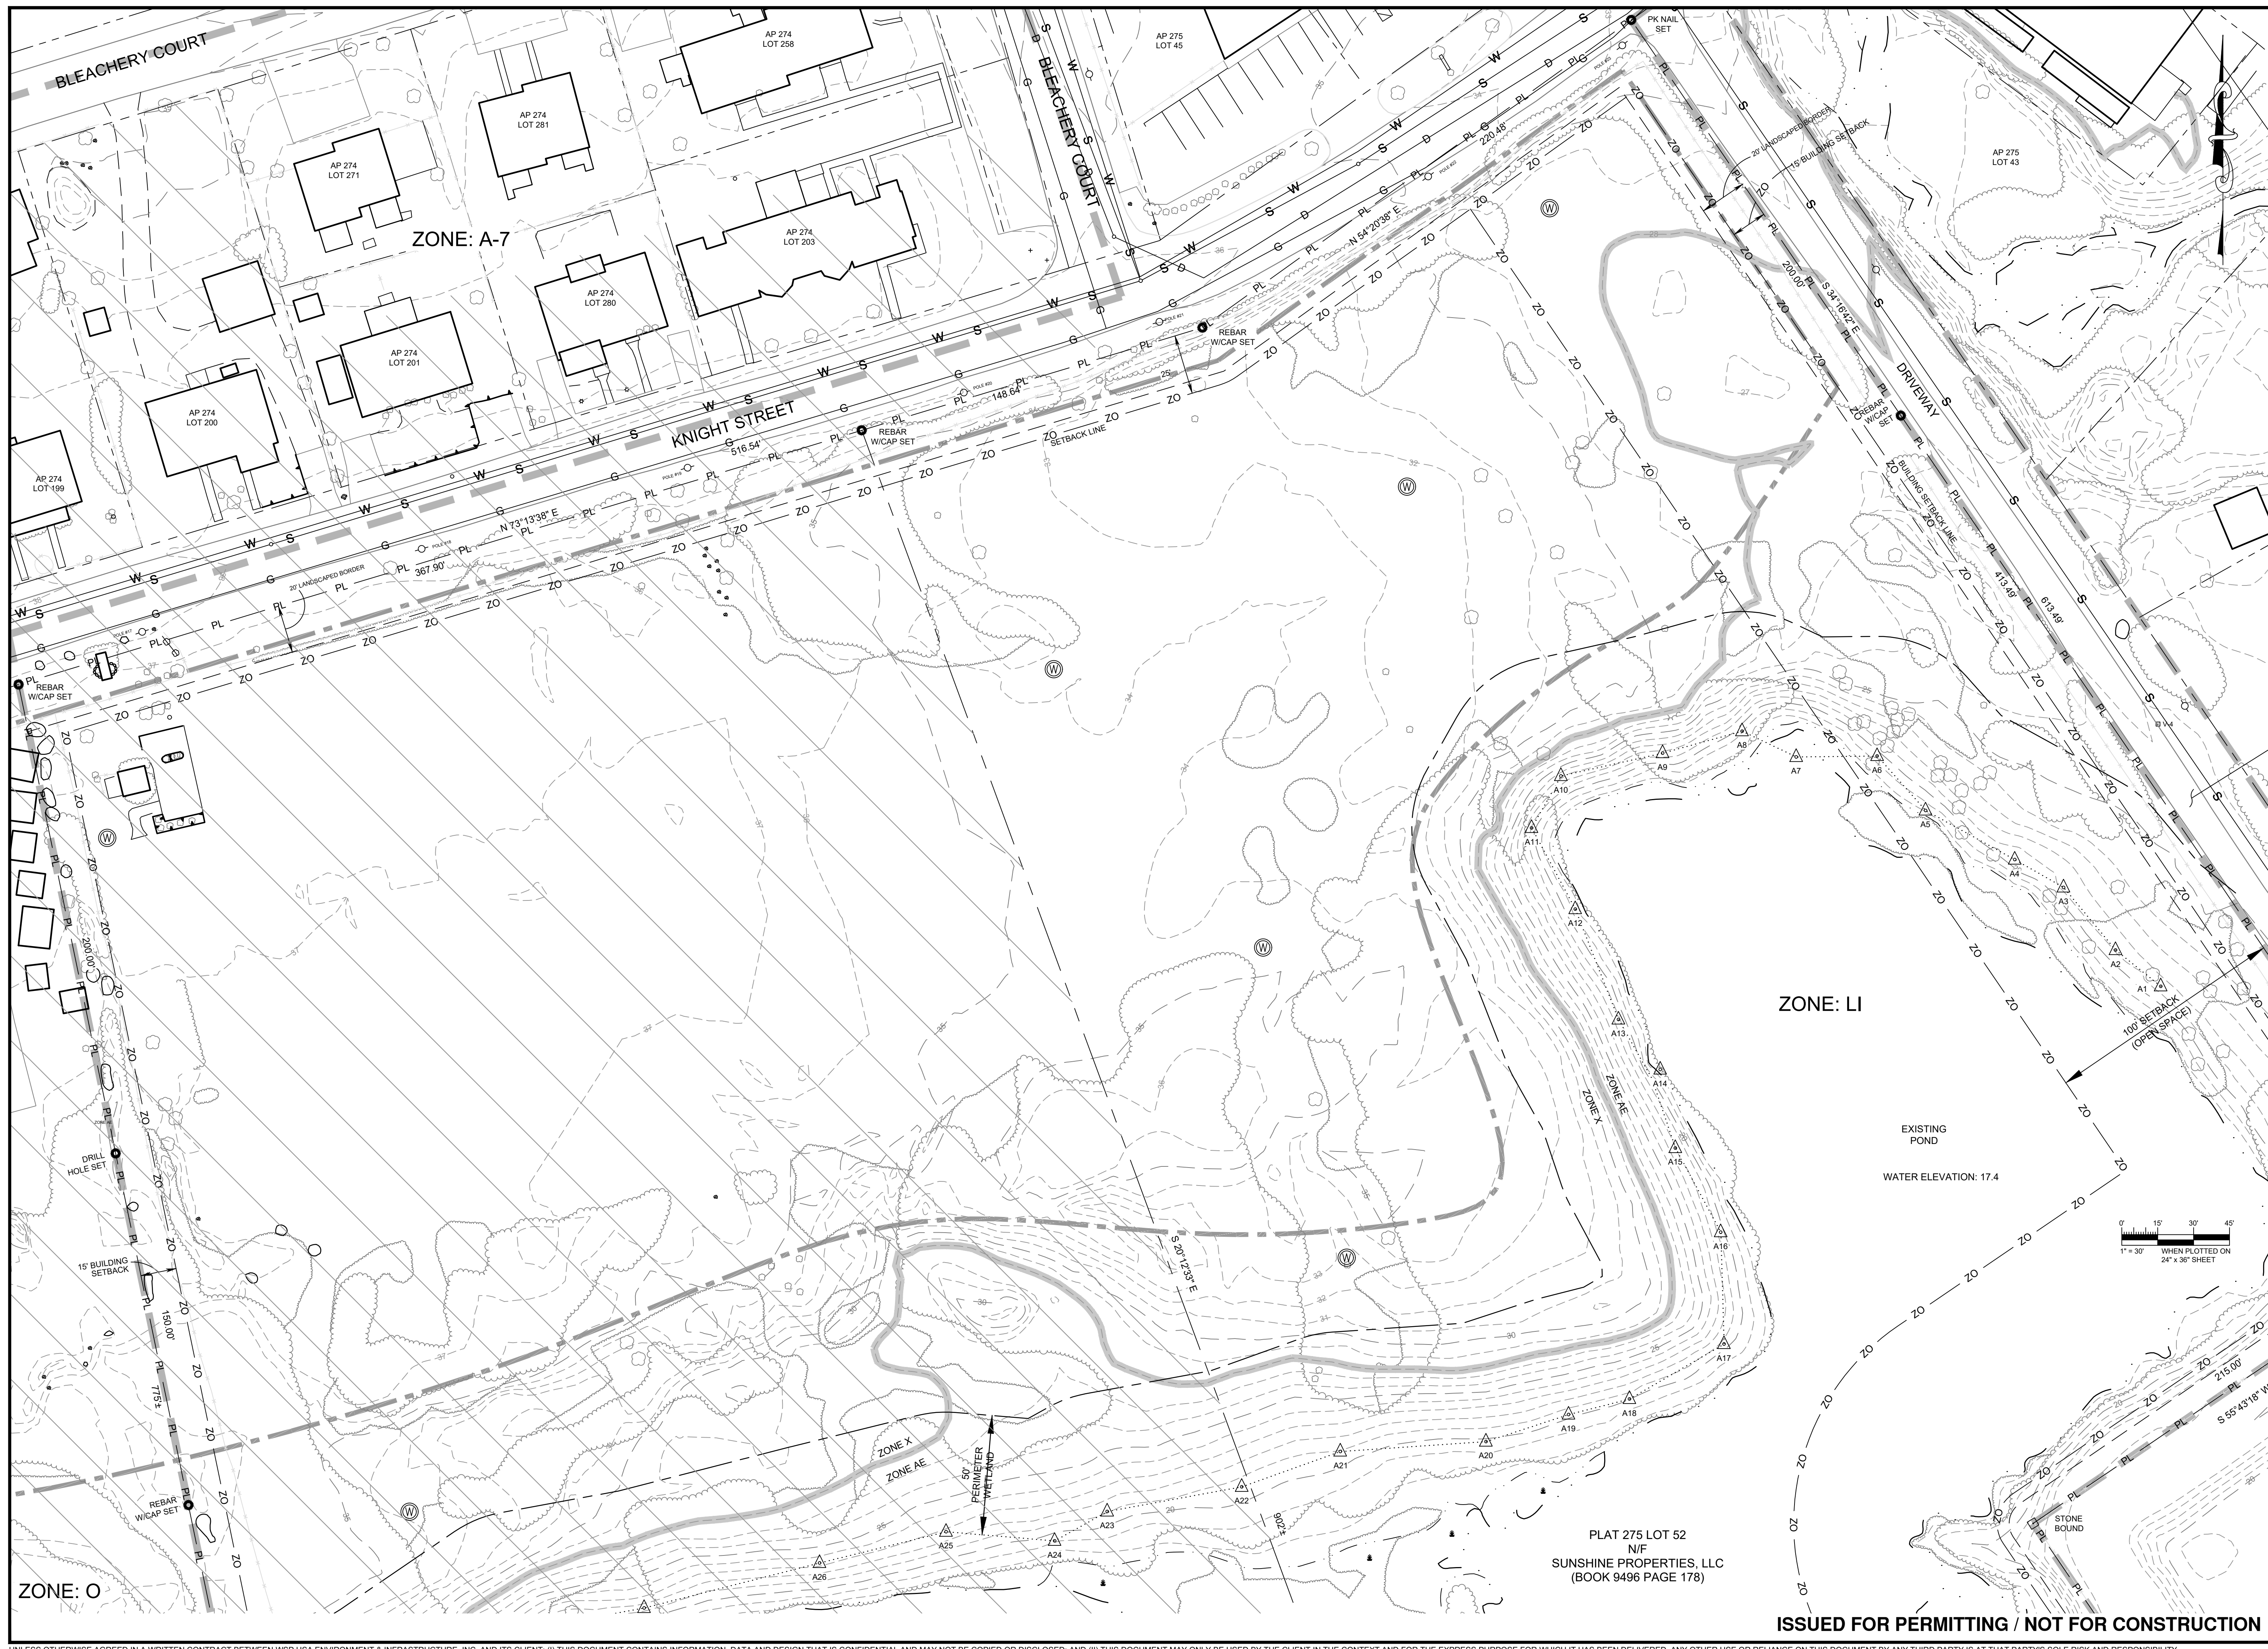

PLAT 275 LOT 52
N/F
SUNSHINE PROPERTIES, LLC
(BOOK 9496 PAGE 178)

ISSUED FOR PERMITTING / NOT FOR CONSTRUCTION


UNLESS OTHERWISE AGREED IN A WRITTEN CONTRACT BETWEEN WSP USA ENVIRONMENT & INFRASTRUCTURE, INC. AND ITS CLIENT: (I) THIS DOCUMENT CONTAINS INFORMATION, DATA AND DESIGN THAT IS CONFIDENTIAL AND MAY NOT BE COPIED OR DISCLOSED; AND (II) THIS DOCUMENT MAY ONLY BE USED BY THE CLIENT IN THE CONTEXT AND FOR THE EXPRESS PURPOSE FOR WHICH IT HAS BEEN DELIVERED. ANY OTHER USE OR RELIANCE ON THIS DOCUMENT BY ANY THIRD PARTY IS AT THAT PARTY'S SOLE RISK AND RESPONSIBILITY.

PROPOSED LEGEND

- UTILITY POLE
- SOLAR ARRAY (1 C-501)
- EQUIPMENT PAD
- GRAVEL ACCESS ROAD (2 C-501)
- CONSTRUCTION ENTRANCE (4 C-501)
- FENCE LINE (8 C-502)
- FENCE LINE WITH PRIVACY SLATS
- EC UNDERGROUND CONDUIT
- OHE OVERHEAD ELECTRIC LINE
- TC LIMIT OF TREE CLEARING
- LOD LIMIT OF DISTURBANCE
- SB SEDIMENT BARRIER (3 C-501)
- HISTORIC ZONING AREA

- ACCESS SIGN ON GATE (7 C-502)
- PROPOSED POINT OF INTERCONNECTION AT EXISTING POLE #17. EXISTING UTILITY POLE TO BE REPLACED WITH 45' C2 POLE
- EXISTING UTILITY POLE #18 TO BE REPLACED WITH 40' C2 POLE
- 20' WIDE CONSTRUCTION ENTRANCE (4 C-501)
- 20' WIDE ACCESS ROAD (C-501)
- 25' RADIUS
- 50' RADIUS

AP 274 LOT 200
AP 274 LOT 201
AP 274 LOT 203
AP 274 LOT 204
AP 274 LOT 205
AP 274 LOT 206
AP 274 LOT 207
AP 274 LOT 208
AP 274 LOT 209
AP 274 LOT 210
AP 274 LOT 211
AP 274 LOT 212
AP 274 LOT 213
AP 274 LOT 214
AP 274 LOT 215
AP 274 LOT 216
AP 274 LOT 217
AP 274 LOT 218
AP 274 LOT 219
AP 274 LOT 220
AP 274 LOT 221
AP 274 LOT 222
AP 274 LOT 223
AP 274 LOT 224
AP 274 LOT 225
AP 274 LOT 226
AP 274 LOT 227
AP 274 LOT 228
AP 274 LOT 229
AP 274 LOT 230
AP 274 LOT 231
AP 274 LOT 232
AP 274 LOT 233
AP 274 LOT 234
AP 274 LOT 235
AP 274 LOT 236
AP 274 LOT 237
AP 274 LOT 238
AP 274 LOT 239
AP 274 LOT 240
AP 274 LOT 241
AP 274 LOT 242
AP 274 LOT 243
AP 274 LOT 244
AP 274 LOT 245
AP 274 LOT 246
AP 274 LOT 247
AP 274 LOT 248
AP 274 LOT 249
AP 274 LOT 250
AP 274 LOT 251
AP 274 LOT 252
AP 274 LOT 253
AP 274 LOT 254
AP 274 LOT 255
AP 274 LOT 256
AP 274 LOT 257
AP 274 LOT 258
AP 274 LOT 259
AP 274 LOT 260
AP 274 LOT 261
AP 274 LOT 262
AP 274 LOT 263
AP 274 LOT 264
AP 274 LOT 265
AP 274 LOT 266
AP 274 LOT 267
AP 274 LOT 268
AP 274 LOT 269
AP 274 LOT 270
AP 274 LOT 271
AP 274 LOT 272
AP 274 LOT 273
AP 274 LOT 274
AP 274 LOT 275
AP 274 LOT 276
AP 274 LOT 277
AP 274 LOT 278
AP 274 LOT 279
AP 274 LOT 280
AP 274 LOT 281
AP 274 LOT 282
AP 274 LOT 283
AP 274 LOT 284
AP 274 LOT 285
AP 274 LOT 286
AP 274 LOT 287
AP 274 LOT 288
AP 274 LOT 289
AP 274 LOT 290
AP 274 LOT 291
AP 274 LOT 292
AP 274 LOT 293
AP 274 LOT 294
AP 274 LOT 295
AP 274 LOT 296
AP 274 LOT 297
AP 274 LOT 298
AP 274 LOT 299
AP 274 LOT 300

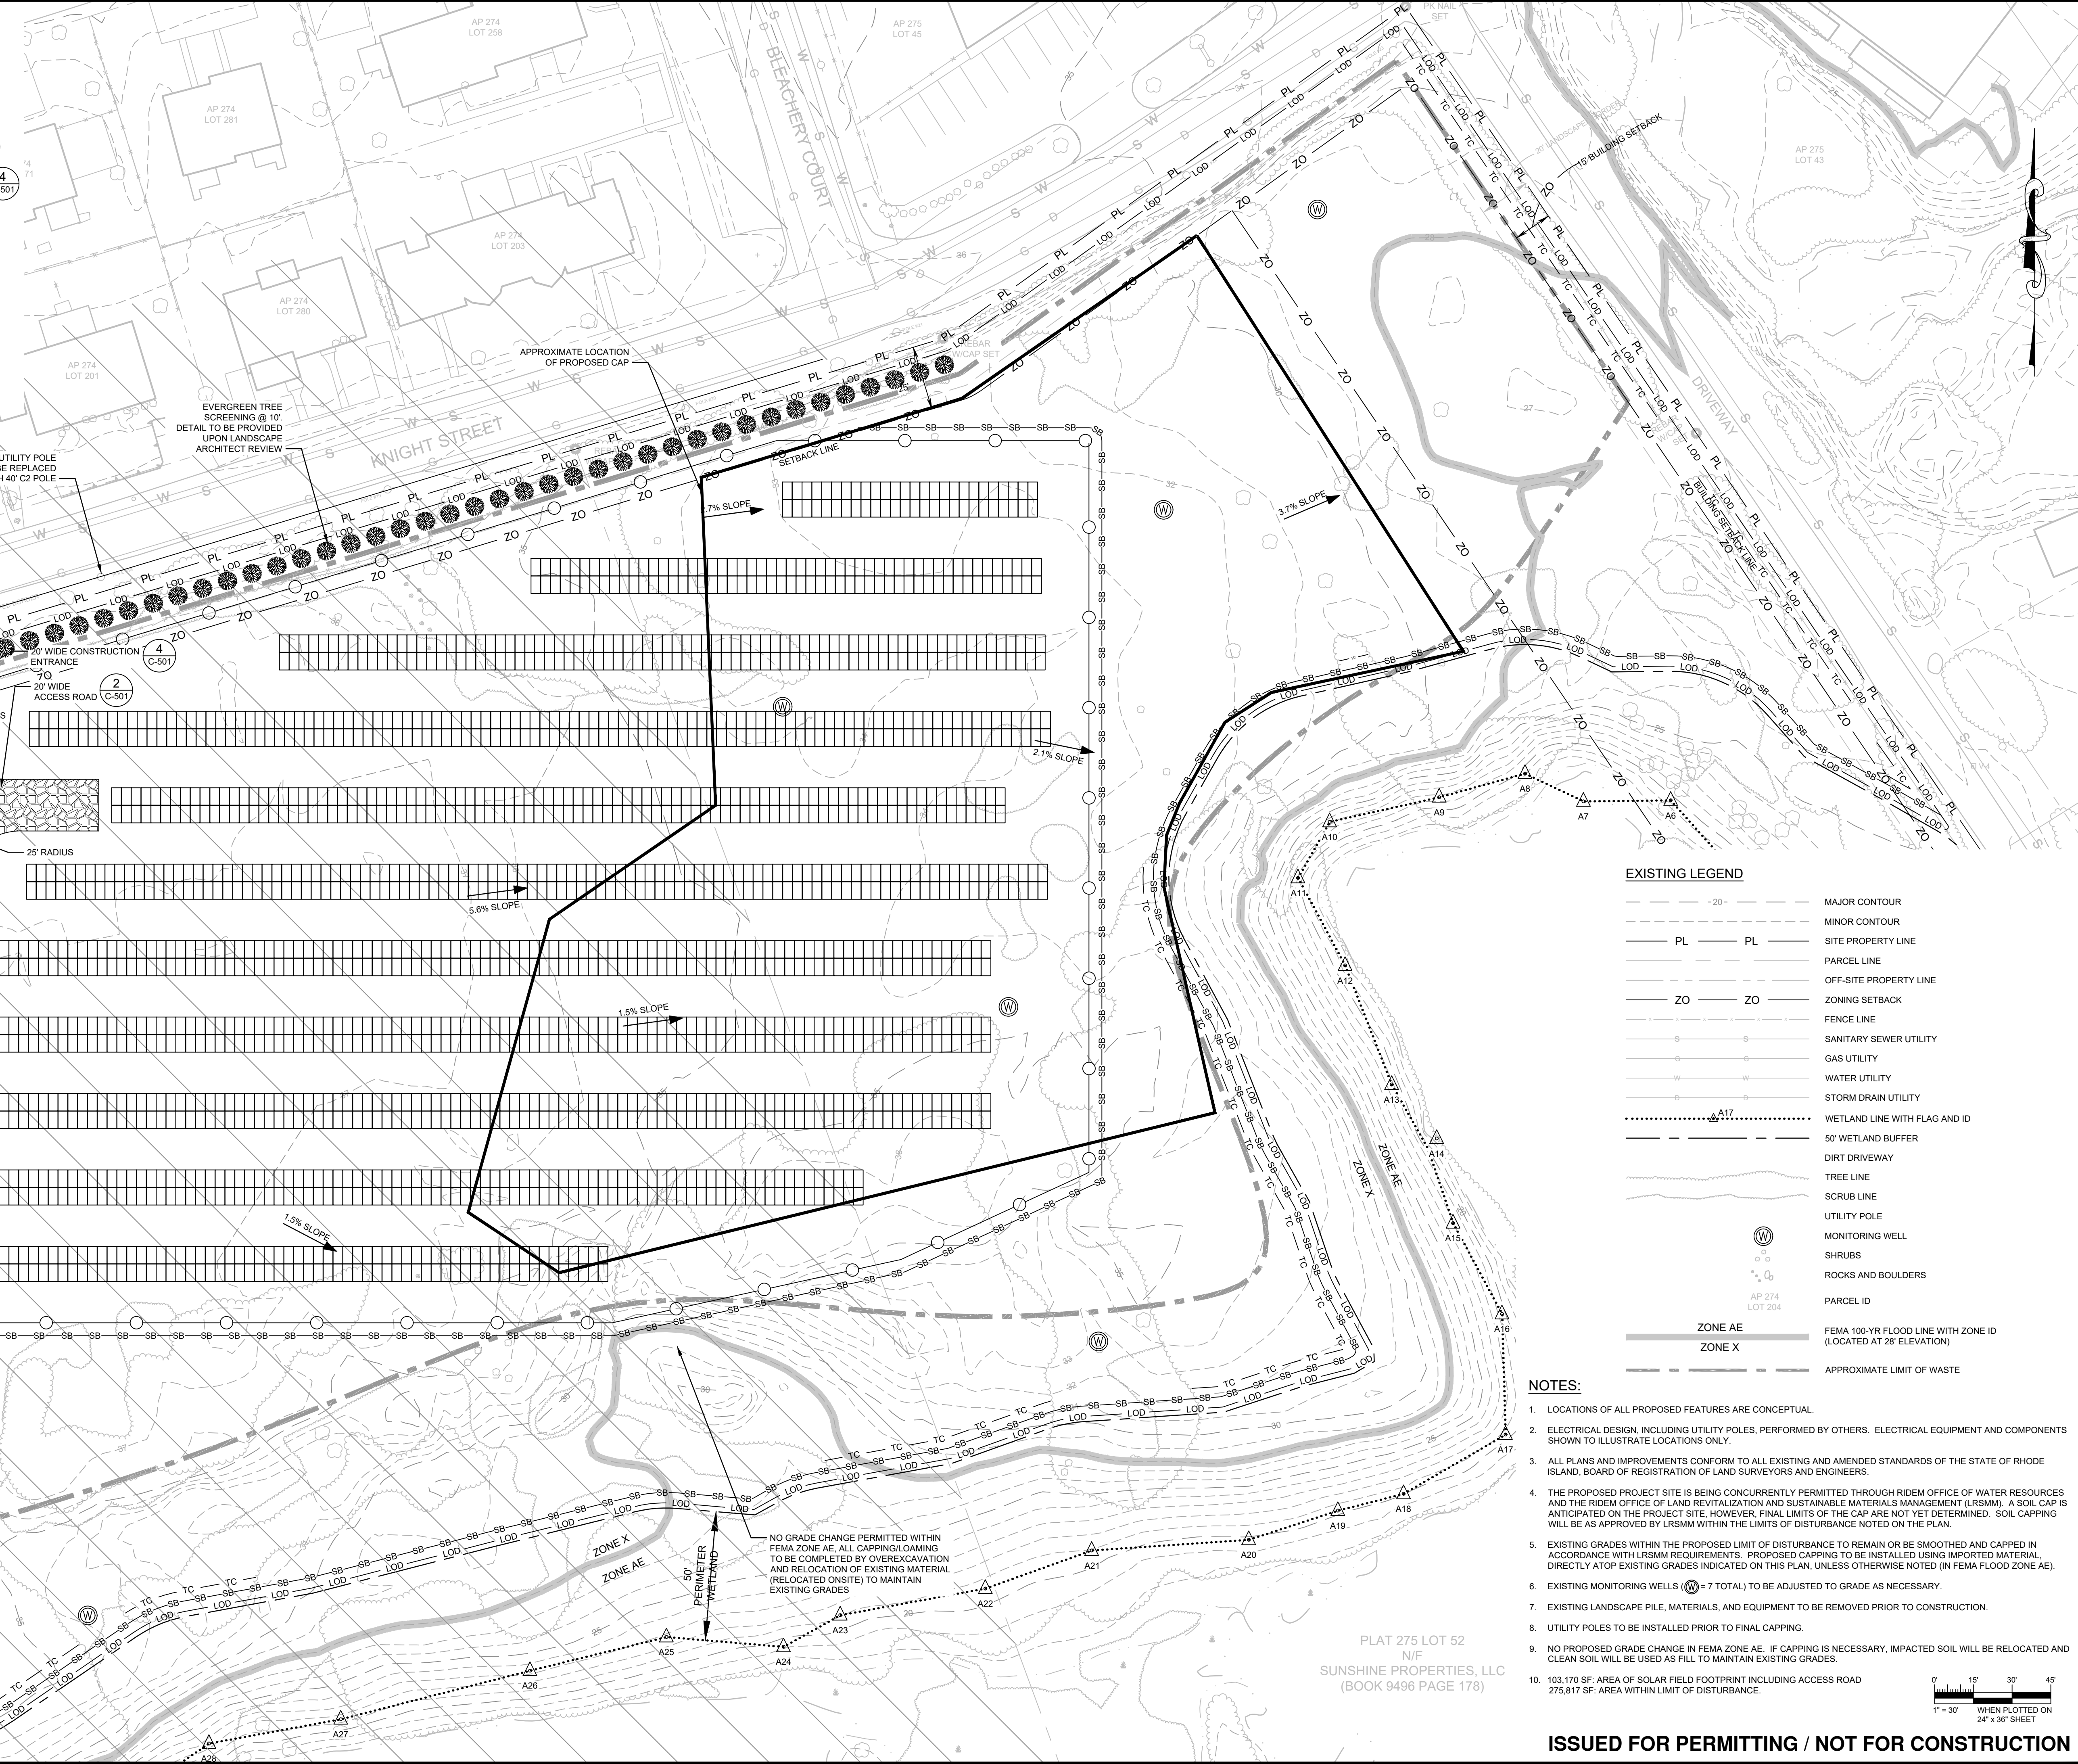


EXISTING LEGEND

- MAJOR CONTOUR
- MINOR CONTOUR
- SITE PROPERTY LINE
- PARCEL LINE
- OFF-SITE PROPERTY LINE
- ZONING SETBACK
- FENCE LINE
- SANITARY SEWER UTILITY
- GAS UTILITY
- WATER UTILITY
- STORM DRAIN UTILITY
- WETLAND LINE WITH FLAG AND ID
- 50' WETLAND BUFFER
- DIRT DRIVEWAY
- TREE LINE
- SCRUB LINE
- UTILITY POLE
- MONITORING WELL
- SHRUBS
- ROCKS AND BOULDERS
- PARCEL ID
- ZONE AE FEMA 100-YR FLOOD LINE WITH ZONE ID (LOCATED AT 28' ELEVATION)
- ZONE X APPROXIMATE LIMIT OF WASTE

NOTES:

1. LOCATIONS OF ALL PROPOSED FEATURES ARE CONCEPTUAL.
2. ELECTRICAL DESIGN, INCLUDING UTILITY POLES, PERFORMED BY OTHERS. ELECTRICAL EQUIPMENT AND COMPONENTS SHOWN TO ILLUSTRATE LOCATIONS ONLY.
3. ALL PLANS AND IMPROVEMENTS CONFORM TO ALL EXISTING AND AMENDED STANDARDS OF THE STATE OF RHODE ISLAND, BOARD OF REGISTRATION OF LAND SURVEYORS AND ENGINEERS.
4. THE PROPOSED PROJECT SITE IS BEING CONCURRENTLY PERMITTED THROUGH RIDEM OFFICE OF WATER RESOURCES AND THE RIDEM OFFICE OF LAND REVITALIZATION AND SUSTAINABLE MATERIALS MANAGEMENT (LRSM). A SOIL CAP IS ANTICIPATED ON THE PROJECT SITE, HOWEVER, FINAL LIMITS OF THE CAP ARE NOT YET DETERMINED. SOIL CAPPING WILL BE AS APPROVED BY LRSM WITHIN THE LIMITS OF DISTURBANCE NOTED ON THE PLAN.
5. EXISTING GRADES WITHIN THE PROPOSED LIMIT OF DISTURBANCE TO REMAIN OR BE SMOOTHED AND CAPPED IN ACCORDANCE WITH LRSM REQUIREMENTS. PROPOSED CAPPING TO BE INSTALLED USING IMPORTED MATERIAL, DIRECTLY ATOP EXISTING GRADES INDICATED ON THIS PLAN, UNLESS OTHERWISE NOTED (IN FEMA FLOOD ZONE AE).
6. EXISTING MONITORING WELLS (W) = 7 TOTAL) TO BE ADJUSTED TO GRADE AS NECESSARY.
7. EXISTING LANDSCAPE PILE, MATERIALS, AND EQUIPMENT TO BE REMOVED PRIOR TO CONSTRUCTION.
8. UTILITY POLES TO BE INSTALLED PRIOR TO FINAL CAPPING.
9. NO PROPOSED GRADE CHANGE IN FEMA ZONE AE. IF CAPPING IS NECESSARY, IMPACTED SOIL WILL BE RELOCATED AND CLEAN SOIL WILL BE USED AS FILL TO MAINTAIN EXISTING GRADES.
10. 103,170 SF: AREA OF SOLAR FIELD FOOTPRINT INCLUDING ACCESS ROAD
275,817 SF: AREA WITHIN LIMIT OF DISTURBANCE.



WSP
WSP USA ENVIRONMENT AND INFRASTRUCTURE, INC.
100 APOLLO DRIVE, SUITE 302
CHELMSFORD, MA 01824
978-692-9090
WSP.COM

REVISION	DATE	ISSUE / REVISION DESCRIPTION
5	2/09/2023	ISSUED FOR PERMITTING / NOT FOR CONSTRUCTION
4	1/19/2023	RESPONSE TO RIBEM COMMENTS
3	9/10/2021	RESPONSE TO RIBEM COMMENTS
2	8/20/2021	ADDRESSED COMMENTS
1	6/29/2021	ISSUED FOR PERMITTING / NOT FOR CONSTRUCTION
0	5/27/2021	ISSUED FOR PERMITTING / NOT FOR CONSTRUCTION


PROJECT: 998.40 KW DC GROUND-MOUNT SOLAR PV DEVELOPMENT
275 KNIGHT STREET
WARWICK, RHODE ISLAND

TITLE: PROPOSED SITE PLAN

CLIENT: VCP, LLC
150 TRUMBULL ST.
HARTFORD, CT 06103

REGISTERED PROFESSIONAL ENGINEER (CIVIL)
No. 12219
02/09/2023

DESIGNED BY: CR
CHECKED BY: GAA
PROJECT NUMBER: 3652200299
DRAWING NUMBER: C-101
SHEET NUMBER: 3 OF 5

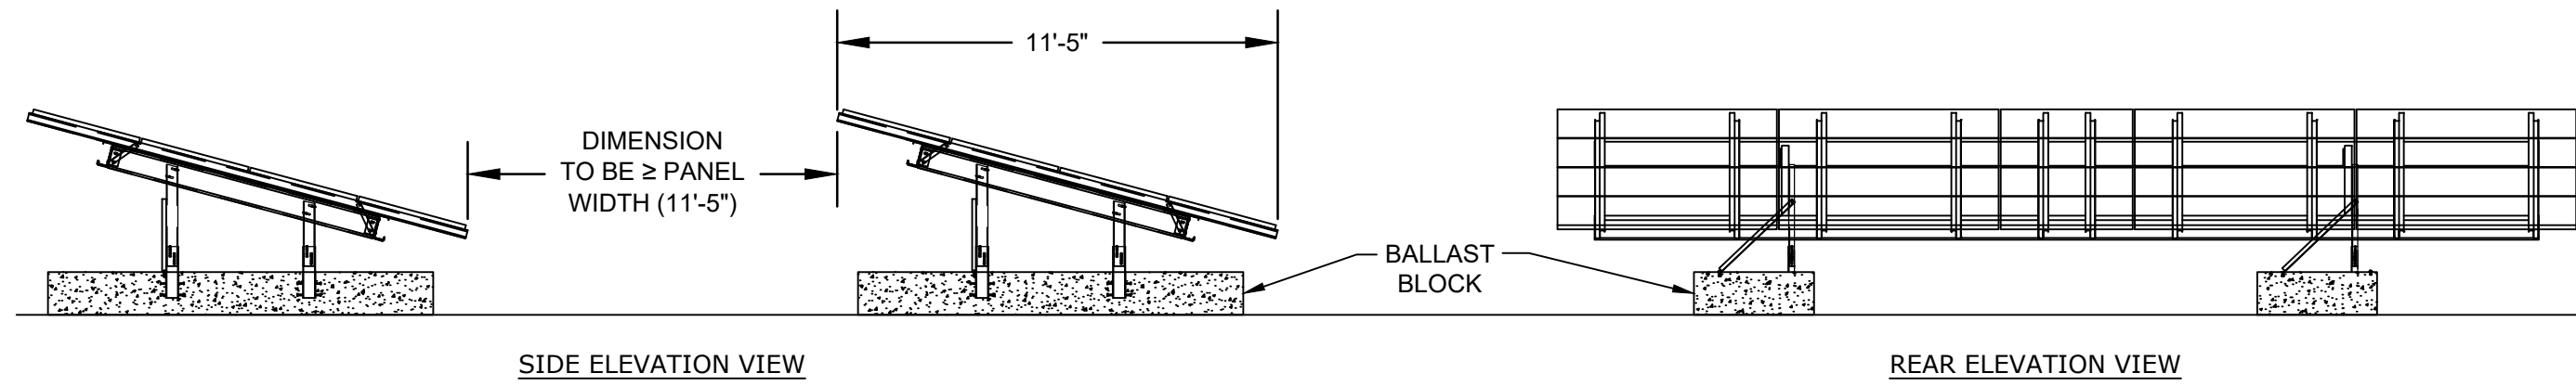


NOTES:

- DESIGN FOR FOUNDATIONS, RACKING, AND MODULES BY OTHERS. DETAILS SHOWN FOR ILLUSTRATION PURPOSES ONLY.
- SEE DETAIL 5 THIS SHEET FOR INTERIOR AND EXTERIOR BLOCK DIMENSIONS.
- ROW SPACING IS EQUAL TO OR GREATER THAN PANEL WIDTH.

SOLAR PV ARRAY

NOT TO SCALE

1

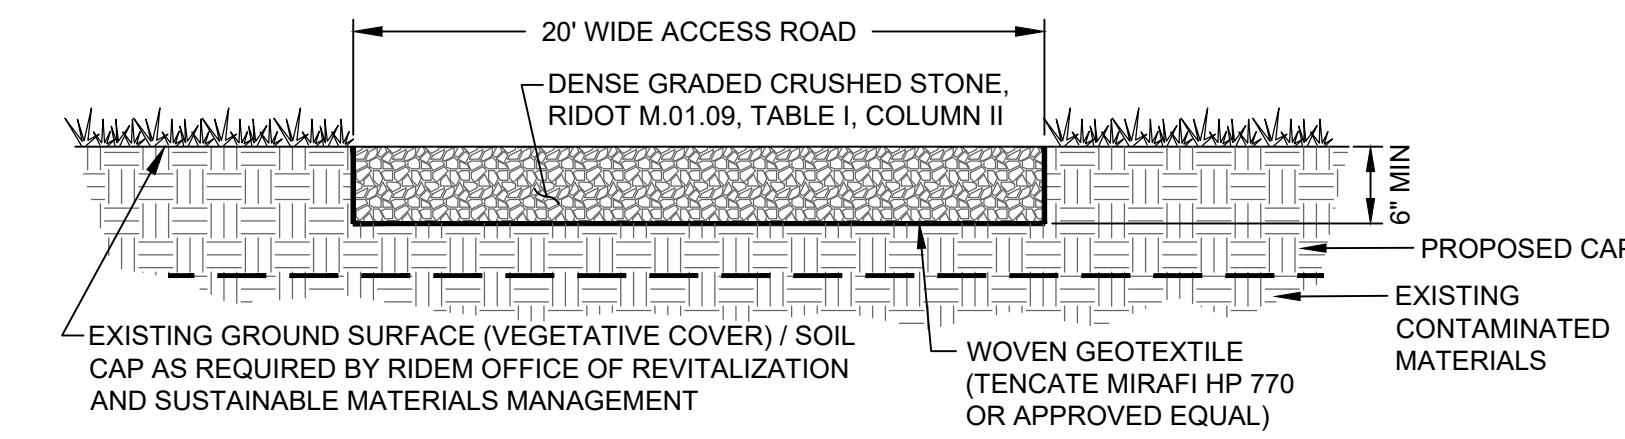



NOTES:

- ACCESS ROAD TO BE CONSTRUCTED OF A MINIMUM 6" OF DENSE GRADED CRUSHED STONE.
- WOVEN GEOTEXTILE TO BE PLACED BETWEEN THE GROUND SURFACE AND THE CRUSHED STONE.
- CRUSHED STONE SHALL BE COMPACTED TO A FIRM AND NON-YIELDING CONDITION.

ACCESS ROAD

NOT TO SCALE

2

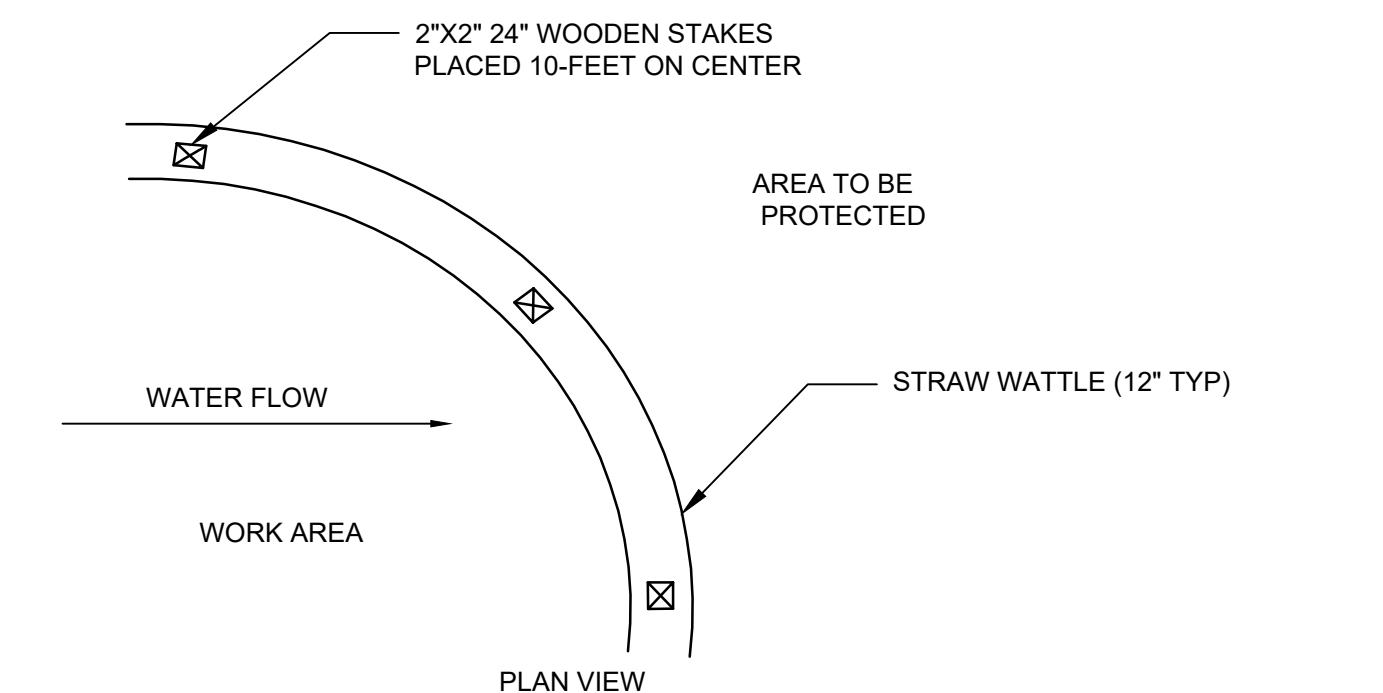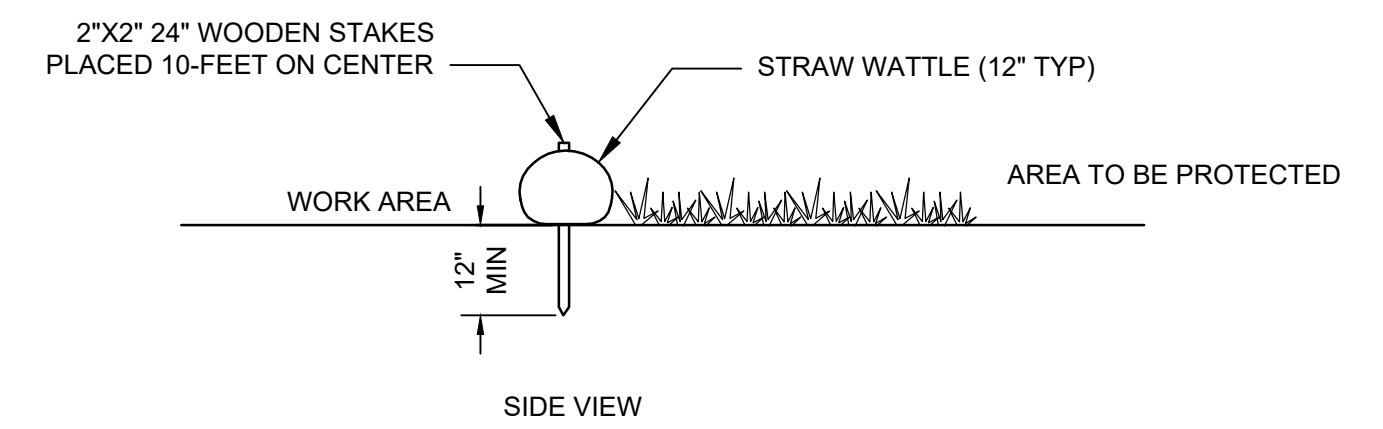

SEDIMENT BARRIER (STRAW WATTLE)

NOT TO SCALE

3

EROSION AND SEDIMENTATION CONTROL PLAN:

THIS PLAN HAS BEEN DEVELOPED TO PROVIDE A STRATEGY FOR CONTROLLING SOIL EROSION AND SEDIMENTATION DURING AND AFTER CONSTRUCTION OF THE PROPOSED PROJECT.


GENERAL EROSION AND SEDIMENTATION CONSTRUCTION DETAIL NOTES:

DURING CONSTRUCTION, THE CONTRACTOR SHALL TAKE ALL REASONABLE MEASURES TO SCHEDULE EARTHWORK OPERATIONS SUCH THAT THE AREA OF EXPOSED AND DISTURBED SOIL IS MINIMIZED. CONSTRUCTION SHALL BE PHASED TO MINIMIZE THE AREA OF DISTURBED SOIL THAT IS EXPOSED AT ANY ONE TIME. UPGRADIENT STORMWATER DIVERSION AND DISPERSION MEASURES SHALL BE INSTALLED WHERE APPROPRIATE. ALL CUT AND FILL SLOPES SHALL BE STABILIZED UPON COMPLETION. THE FOLLOWING MEASURES WILL BE UNDERTAKEN TO PROVIDE MAXIMUM PROTECTION TO THE SOIL, WATER, AND ADJUTING LANDS:

- PRIOR TO GRUBBING OR ANY EARTH MOVING OPERATION, SEDIMENT BARRIERS, OR OTHER APPROPRIATE PERIMETER CONTROL BEST MANAGEMENT PRACTICES (BMPs) SHALL BE INSTALLED ACROSS THE SLOPE ON THE CONTOUR AT THE DOWNHILL LIMIT OF THE WORK AS PROTECTION AGAINST CONSTRUCTION RELATED EROSION. INSTALL ALL NECESSARY STORMWATER DIVERSIONS AND DISPERSION MEASURES.
- PERMANENT SOIL STABILIZATION MEASURES FOR ALL SLOPES, OR ANY DISTURBED LAND AREA SHALL BE COMPLETED WITHIN FOURTEEN CALENDAR DAYS AFTER FINAL GRADING HAS BEEN COMPLETED. WHEN IT IS NOT POSSIBLE OR PRACTICAL TO PERMANENTLY STABILIZE DISTURBED LAND, TEMPORARY EROSION CONTROL MEASURES SHALL BE IMPLEMENTED ON DISTURBED AREAS (INCLUDING STOCKPILES) WITHIN FOURTEEN CALENDAR DAYS OF EXPOSURE OF SOIL OR FORMATION OF PILES. UNLESS THESE AREAS ARE TO BE SUBSEQUENTLY SURFACED WITH PERMANENT STRUCTURES. ALL DISTURBED AREAS SHALL BE MULCHED FOR EROSION CONTROL UPON COMPLETION OF ROUGH GRADING.
- ANY EXPOSED SLOPES 3:1 OR GREATER SHALL BE STABILIZED WITH EROSION CONTROL BLANKETS (ERONET C125 BY NORTH AMERICAN GREEN, OR APPROVED EQUAL) TO PREVENT EROSION DURING CONSTRUCTION AND TO FACILITATE REVEGETATION AFTER TOPSOILING AND SEEDING.
- IF MATERIAL STOCKPILES ARE NEEDED, SEDIMENT BARRIER SHALL BE INSTALLED AT THE BASE OF STOCKPILES AT THE DOWNHILL LIMIT TO PROTECT AGAINST EROSION. STOCKPILES ANTICIPATED TO REMAIN FOR MORE THAN FOURTEEN CALENDAR DAYS SHALL BE STABILIZED BY SEEDING AND MULCHING UPON FORMATION OF THE PILES. UPGRADIENT OF THE STOCKPILES, STABILIZED DITCHES AND/OR BERMS SHALL BE CONSTRUCTED TO DIVERT STORMWATER RUNOFF AWAY FROM THE PILES.
- INTERCEPTED SEDIMENT SHALL BE REMOVED WHEN IT REACHES ONE-HALF THE HEIGHT OF THE SEDIMENT BARRIER, OR AS DIRECTED IN THE DRAWING DETAILS FOR OTHER BMPs, AND SHALL BE DEPOSITED IN AN AREA THAT SHALL NOT CONTRIBUTE TO SEDIMENT OFF-SITE AND CAN BE PERMANENTLY STABILIZED. ALL DAMAGED EROSION CONTROL DEVICES SHALL BE REPAIRED AND/OR REPLACED IMMEDIATELY. DEVICES NO LONGER SERVICEABLE DUE TO SEDIMENT ACCUMULATION SHALL ALSO BE REPAIRED AND/OR REPLACED AS REQUIRED.
- SOIL CUTTINGS GENERATED DURING THE DRILLING OF PILOT HOLES FOR FOUNDATION POSTS SHALL BE REMOVED AND COLLECTED. SOIL CUTTINGS MAY BE STOCKPILED TEMPORARILY, BUT ULTIMATELY SHALL BE DISPOSED AND SPREAD IN AN AREA THAT SHALL NOT CONTRIBUTE TO OFF-SITE SEDIMENTATION, AND PERMANENTLY STABILIZED.
- ADDITIONAL EROSION CONTROL METHODS SHALL BE IMPLEMENTED IF CONSTRUCTION OCCURS AFTER DECEMBER 15TH. ALL DISTURBED AREAS SHALL BE MINIMIZED TO THE EXTENT POSSIBLE. PRIOR TO FREEZING, ADDITIONAL EROSION CONTROL DEVICES SHALL BE INSTALLED AS APPROPRIATE. INSPECTION OF THESE EROSION CONTROL ITEMS SHALL BE FREQUENT, WITH PARTICULAR ATTENTION PAID TO WEATHER PREDICTIONS TO ENSURE THAT THESE MEASURES ARE PROPERLY IN PLACE TO HANDLE LARGE QUANTITIES OF RUNOFF RESULTING FROM HEAVY RAINS OR EXCESSIVE THAWS.
- GENERAL EROSION AND SEDIMENTATION CONTROL ACTIONS SHALL INCLUDE THE FOLLOWING:
 - MARK SOIL DISTURBANCE LIMITS
 - INSTALL SEDIMENT BARRIERS BEFORE DISTURBING ANY SOILS
 - DIVERT AND DISPERSE STORMWATER RUNOFF TO UNDISTURBED AREAS WHEREVER POSSIBLE
 - MULCH DISTURBED AREAS
 - PROTECT STEEP SLOPES
 - INSPECT AND REPAIR EROSION CONTROLS AND SEDIMENT BARRIERS

DUST CONTROL:

- CONSTRUCTION ACTIVITIES SHALL BE SCHEDULED TO MINIMIZE THE AREA OF DISTURBED SOIL THAT IS EXPOSED AT ONE TIME.
- DUST CONTROL SHALL BE USED ON CONSTRUCTION ROUTES AND OTHER DISTURBED AREAS SUBJECT TO SURFACE DUST MOVEMENT AND DUST BLOWING.
- MAINTAIN DUST CONTROL MEASURES PROPERLY THROUGH DRY WEATHER PERIODS UNTIL ALL DISTURBED AREAS HAVE BEEN PERMANENTLY STABILIZED.
- DUST CONTROL METHODS SHALL BE APPROVED BY THE ENGINEER AND MAY INCLUDE VEGETATIVE COVER, MULCH (INCLUDING GRAVEL MULCH), SPRAY-ON-ADHESIVE, CALCIUM CHLORIDE, SPRINKLING, STONE, AND BARRIERS.
- VEGETATIVE COVER - FOR DISTURBED AREAS NOT SUBJECT TO TRAFFIC, VEGETATION PROVIDES THE MOST PRACTICAL METHOD OF DUST CONTROL.
- MULCH (INCLUDING GRAVEL MULCH) - WHEN PROPERLY APPLIED, MULCH OFFERS A FAST, EFFECTIVE MEANS OF CONTROLLING DUST. SEE MANUFACTURER'S RECOMMENDATIONS OR THE RHODE ISLAND SOIL EROSION AND SEDIMENT CONTROL HANDBOOK FOR APPLICATION RATES.
- SPRAY-ON ADHESIVE - LATEX EMULSIONS OR RESIN IN WATER CAN BE SPRAYED ONTO MINERAL SOIL TO PREVENT PARTICLES FROM BLOWING AWAY.
- CALCIUM CHLORIDE - CALCIUM CHLORIDE MAY BE APPLIED BY MECHANICAL SPREADER AS LOOSE, DRY GRANULES OR FLAKES AT A RATE THAT KEEPS THE SURFACE MOIST BUT NOT SO HIGH AS TO CAUSE WATER POLLUTION OR PLANT DAMAGE.
- SPRINKLING - EXPOSED SOILS MAY BE SPRINKLED UNTIL THE SURFACE IS WET. SPRINKLING IS ESPECIALLY EFFECTIVE FOR DUST CONTROL ON HAUL ROADS AND OTHER TRAFFIC ROUTES.
- STONE - USED TO STABILIZE CONSTRUCTION ROADS; CAN ALSO BE EFFECTIVE FOR DUST CONTROL.
- BARRIERS - A BOARD FENCE, WIND FENCE, SEDIMENT FENCE, OR SIMILAR BARRIER CAN CONTROL AIR CURRENTS AND BLOWING SOIL. ALL OF THESE FENCES ARE NORMALLY CONSTRUCTED OF WOOD AND THEY PREVENT EROSION BY OBSTRUCTING THE WIND NEAR THE GROUND AND PREVENTING THE SOIL FROM BLOWING OFFSITE.

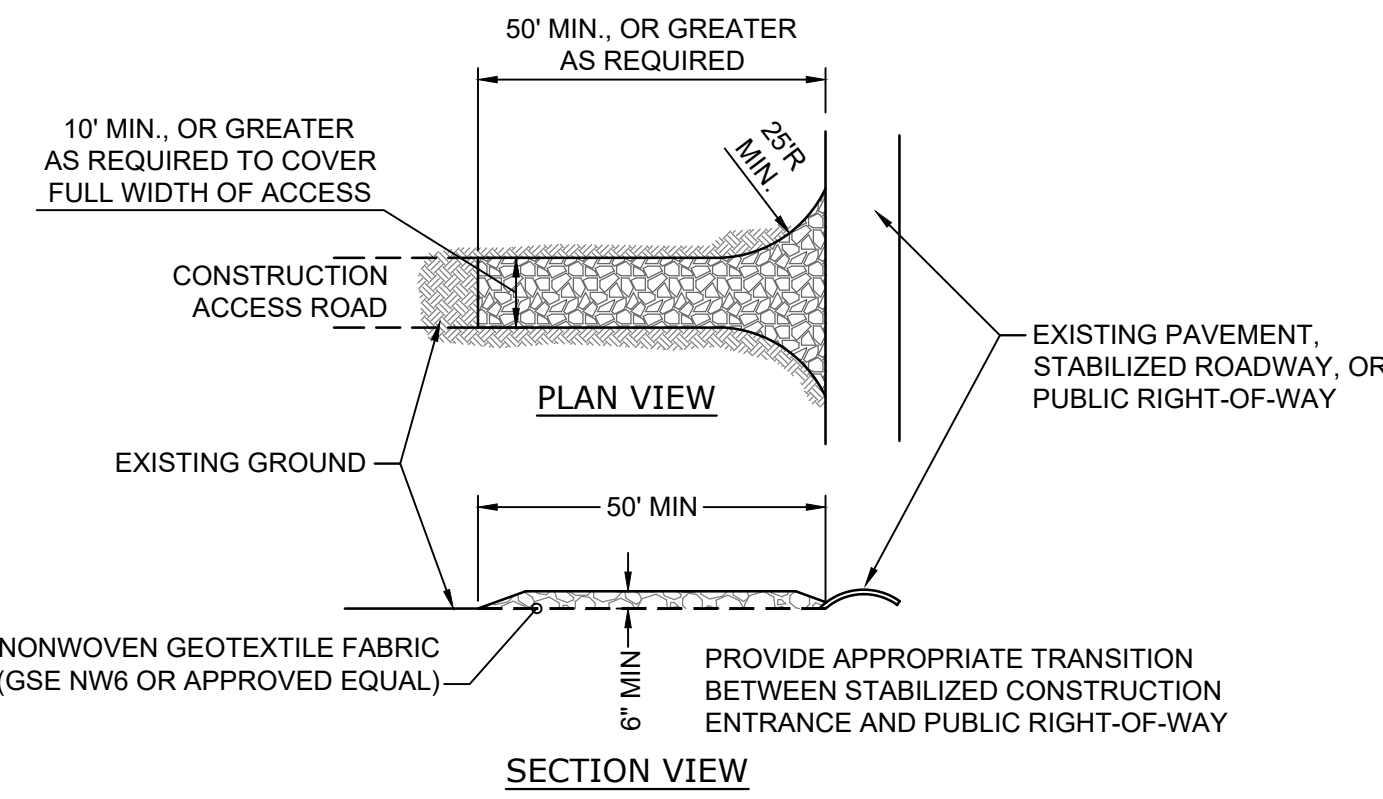


NOTES:

- STONE TO BE 1"-3" STONE, RECLAIMED STONE, OR RECYCLED CONCRETE EQUIVALENT.
- LENGTH - AS REQUIRED, BUT NOT LESS THAN 50 FT.
- THICKNESS - NOT LESS THAN SIX (6) INCHES.
- WIDTH - TEN (10) FT. MIN, BUT NOT LESS THAN THE FULL TRAVELED WIDTH AT POINTS WHERE INGRESS OR EGRESS OCCURS.
- FILTER CLOTH - SHALL BE PLACED OVER THE ENTIRE AREA PRIOR TO PLACING OF STONE.
- SURFACE WATER - ALL SURFACE WATER FLOWING OR DIVERTED TOWARD CONSTRUCTION ENTRANCE SHALL BE PIPED ACROSS OR BENEATH THE ENTRANCE.
- MAINTENANCE - THE ENTRANCE SHALL BE MAINTAINED IN A CONDITION WHICH WILL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO PUBLIC RIGHTS-OF-WAY. THIS MAY REQUIRE PERIODIC TOP DRESSING WITH ADDITIONAL STONE AS CONDITIONS DEMAND AND REPAIR AND/OR CLEANOUT OF ANY MEASURES USED TO TRAP SEDIMENT. ALL SEDIMENT SPILLED, DROPPED, WASHED OR TRACKED ONTO PUBLIC RIGHTS-OF-WAY MUST BE REMOVED IMMEDIATELY.
- WASHING - WHEELS SHALL BE CLEANED TO REMOVE SEDIMENT PRIOR TO ENTRANCE ONTO PUBLIC RIGHTS-OF-WAY. IF WASHING IS REQUIRED, IT SHALL BE DONE ON AN AREA STABILIZED WITH STONE AND WHICH DRAINS INTO AN APPROVED SEDIMENT TRAPPING DEVICE.
- PERIODIC INSPECTION AND NEEDED MAINTENANCE SHALL BE PROVIDED AFTER EACH RAIN.

STABILIZED CONSTRUCTION ENTRANCE

NOT TO SCALE

4

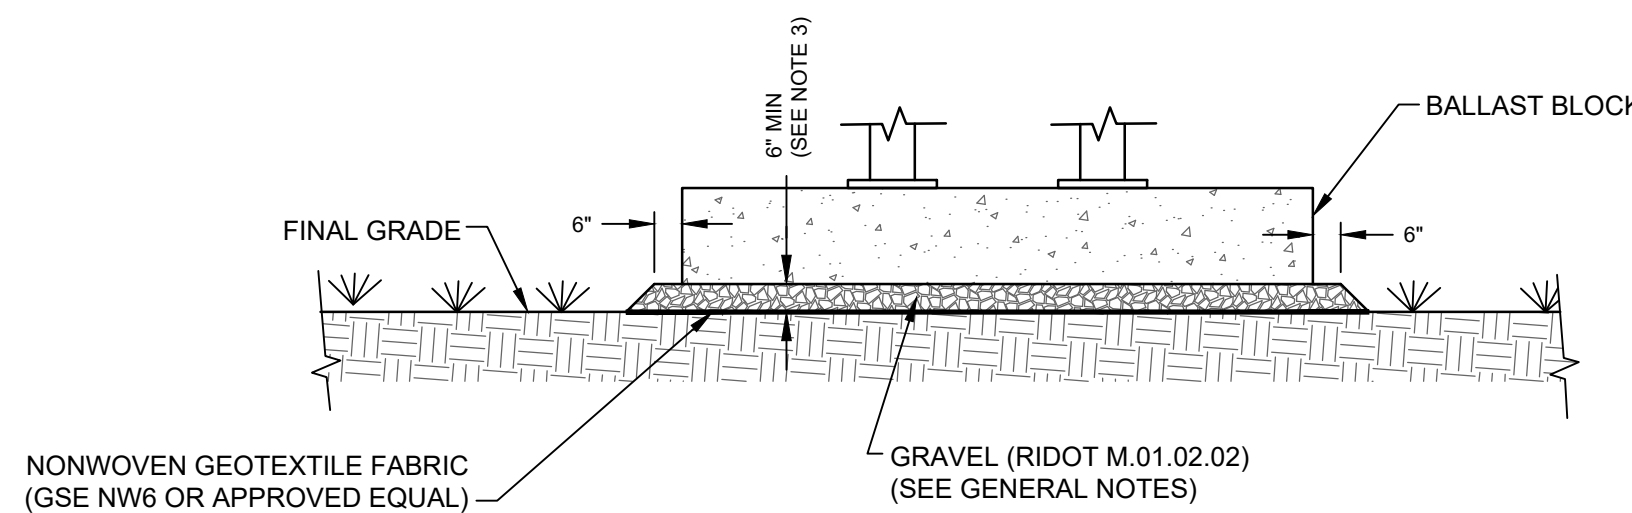

NOTES:

- MINIMUM 6" GRAVEL TO BE PLACED 6" BEYOND ALL SIDES OF THE BLOCK.
- CONTRACTOR SHALL INSTALL A MINIMUM OF 6" OF GRAVEL ON TOP OF THE EXISTING VEGETATIVE SUPPORT LAYER AFTER CUTTING EXISTING VEGETATION AS SHORT AS POSSIBLE.
- ACTUAL BALLAST BLOCK DIMENSIONS MAY CHANGE; TOTAL BALLAST BLOCK AREA SHALL NOT EXCEED 6,000 SQFT.

BALLAST INSTALLATION

NOT TO SCALE

5

MONITORING PROGRAM:

- EROSION AND SEDIMENTATION CONTROLS SHALL BE INSPECTED AT LEAST ONCE EVERY 7 CALENDAR DAYS AND WITHIN 24 HOURS OF THE END OF A STORM EVENT OF 0.25 INCHES OR GREATER. DAILY RAINFALL SHALL BE MONITORED AND RECORDED BY THE CONTRACTOR. ALL STRUCTURES DAMAGED BY CONSTRUCTION EQUIPMENT, VANDALS, OR THE ELEMENTS SHALL BE REPAIRED OR REPLACED IMMEDIATELY, PRIOR TO CONTINUING THE CONSTRUCTION.
- FOLLOWING THE FINAL SEEDING, THE SITE SHALL BE INSPECTED IN ACCORDANCE WITH THE SCHEDULE OUTLINED IN #1 ABOVE, TO ENSURE THAT THE VEGETATION HAS BEEN ESTABLISHED (70% COVER ACHIEVED). IN THE EVENT OF ANY UNSATISFACTORY GROWTH, RESEEDING WILL BE CARRIED OUT, WITH FOLLOW-UP INSPECTION.
- AFTER THE CONSTRUCTION INSPECTOR HAS DETERMINED THAT THE PROJECT AREA HAS BEEN PERMANENTLY STABILIZED (70% COVER HAS BEEN ACHIEVED OR NON-VEGETATED MEASURES HAVE BEEN IMPLEMENTED), THE CONTRACTOR SHALL REMOVE ALL SEDIMENT BARRIERS, TEMPORARY SEDIMENTATION CONTROL RISERS AND ANY OTHER TEMPORARY EROSION CONTROL MEASURES.

SEEDING AND REVEGETATION PLAN:

UPON COMPLETION OF SITE CONSTRUCTION, ALL AREAS PREVIOUSLY DISTURBED SHALL BE TREATED AS STATED BELOW. THESE AREAS WILL BE CLOSELY MONITORED BY THE CONTRACTOR UNTIL SUCH TIME AS A SATISFACTORY GROWTH OF VEGETATION IS ESTABLISHED. SATISFACTORY GROWTH SHALL MEAN A MINIMUM OF 70% OF THE AREA IS VEGETATED WITH VIGOROUS GROWTH.

- TOPSOIL WILL BE SPREAD OVER ALL DISTURBED AREAS TO BE REVEGETATED AND SHALL BE GRADED TO A UNIFORM DEPTH OF FOUR (4) TO SIX (6) INCHES.
- APPLY SEED AS DIRECTED BELOW:
 - (APRIL 1ST THROUGH OCTOBER 1ST)
 - SEED DISTURBED AREAS AT THE RATE OF 4 LBS PER 1,000 SQ. FT. OF THE FOLLOWING MIXTURE:
 - ERNST SEEDS ERNMX-105 OR APPROVED EQUAL
 - APPLY WOOD FIBER MULCH AT A RATE OF 2,000 LBS PER ACRE FOR MAXIMUM MOISTURE RETENTION.
 - (NOVEMBER 1ST THROUGH DECEMBER 15TH)
 - SEED DISTURBED AREAS AT THE RATE OF 8 LBS PER 1,000 SQ. FT. OF THE FOLLOWING MIXTURE:
 - ERNST SEEDS ERNMX-105 OR APPROVED EQUAL
 - APPLY HAY MULCH AT THE RATE OF 100 LBS PER 1,000 SQ. FT.
 - (AFTER DECEMBER 15TH)
 - DO NOT SEED.
 - APPLY HAY MULCH AT THE RATE OF 100 LBS PER 1,000 SQ. FT.
 - FERTILIZER AND LIME SELECTIONS BASED ON SOIL TESTING IS RECOMMENDED. IN ABSENCE OF A SOIL TEST, APPLY LIME AT A RATE OF 2.5 TONS PER ACRE AND 10-20-20 FERTILIZER AT A RATE OF 500 POUNDS PER ACRE. 40% OF THE NITROGEN SHALL BE IN AN ORGANIC OR SLOW-RELEASED FORM. THE TARGET PH FOR LIMED SOIL IS 5.5 - 6.0. LIME AND FERTILIZER SHALL BE INCORPORATED INTO THE TOP 2-3 INCHES OF SOIL. FERTILIZER WILL ONLY BE USED AS NECESSARY TO ESTABLISH INITIAL VEGETATIVE GROWTH.
 - SEEDING METHODS MAY BE DRILL SEEDINGS, BROADCASTS AND ROLLED, CULTRIPACKED, OR TRACKED WITH A SMALL TRACK PIECE OF CONSTRUCTION EQUIPMENT, OR HYDRO-SEEDING, WITH SUBSEQUENT TRACKING.
 - WATERING MAY BE REQUIRED DURING DRY PERIODS CONSULT SEED MANUFACTURER'S INSTRUCTIONS.
 - STEEP SLOPES (3:1 AND STEEPER) SHALL BE STABILIZED BY INSTALLING EROSION CONTROL BLANKET (ERONET C125 BY NORTH AMERICAN GREEN, OR APPROVED EQUAL).
 - INSPECT SEEDED AREAS FOR FAILURE AND MAKE NECESSARY REPAIRS AND RESEED IMMEDIATELY. CONDUCT A FOLLOW-UP SURVEY AFTER ONE YEAR AND RESEED WHERE NECESSARY.
 - IF THERE ARE AREAS WITH LESS THAN 40% COVER, REEVALUATE CHOICE OF PLANT MATERIALS AND QUANTITIES OF LIME AND FERTILIZER. IF THE SEASON PREVENTS RESEEDING, MULCH OR JUTE NETTING IS AN EFFECTIVE TEMPORARY COVER.
 - SEEDED AREAS SHOULD BE FERTILIZED DURING THE SECOND GROWING SEASON.
 - LIME AND FERTILIZER THEREAFTER AT PERIODIC INTERVALS, AS NEEDED. HERBICIDES SHALL NOT BE USED.
 - ALL SEDIMENT CONTROL STRUCTURES LOCATED DOWN GRADIENT OF SOILS STABILIZED BY VEGETATIVE MEASURES SHALL REMAIN IN PLACE UNTIL VEGETATION IS ESTABLISHED. ESTABLISHED MEANS A MINIMUM OF 85% OF THE AREA IS VEGETATED WITH VIGOROUS GROWTH.
 - THE USE OF FUNGICIDES, PESTICIDES, HERBICIDES, INSECTICIDES, CHEMICALS, OR SOLVENTS SHALL BE PROHIBITED.




REVISED PER CITY COMMENTS	ISSUED FOR PERMITTING / NOT FOR CONSTRUCTION	RESPONSE TO RIBEM COMMENTS	RESPONSE TO RIBEM COMMENTS	ADDRESSED COMMENTS	ISSUED FOR PERMITTING / NOT FOR CONSTRUCTION	ISSUE / REVISION DESCRIPTION	DATE	REVISION
2/09/2023								5
1/19/2023								4
9/10/2021								3
8/20/2021								2
6/28/2021								1
5/27/2021								0

PROJECT: 998.40 KW DC GROUND-MOUNT SOLAR PV DEVELOPMENT
275 KNIGHT STREET
WARWICK, RHODE ISLAND

TITLE: CONSTRUCTION, EROSION, AND SEDIMENTATION CONTROL DETAILS AND NOTES


CLIENT: VCP, LLC
150 TRUMBULL ST.
HARTFORD, CT 06103

VEROGEY

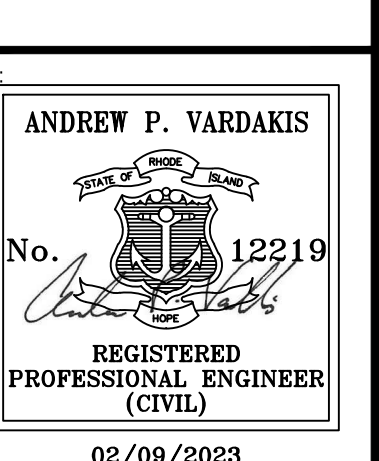

DESIGNED BY: CR	DRAWN BY: BEG
CHECKED BY: GAA	SCALE: AS SHOWN
PROJECT NUMBER: 3652200299	DRAWING NUMBER: C-501
SHEET NUMBER: 4 OF 5	


ISSUED FOR PERMITTING / NOT FOR CONSTRUCTION

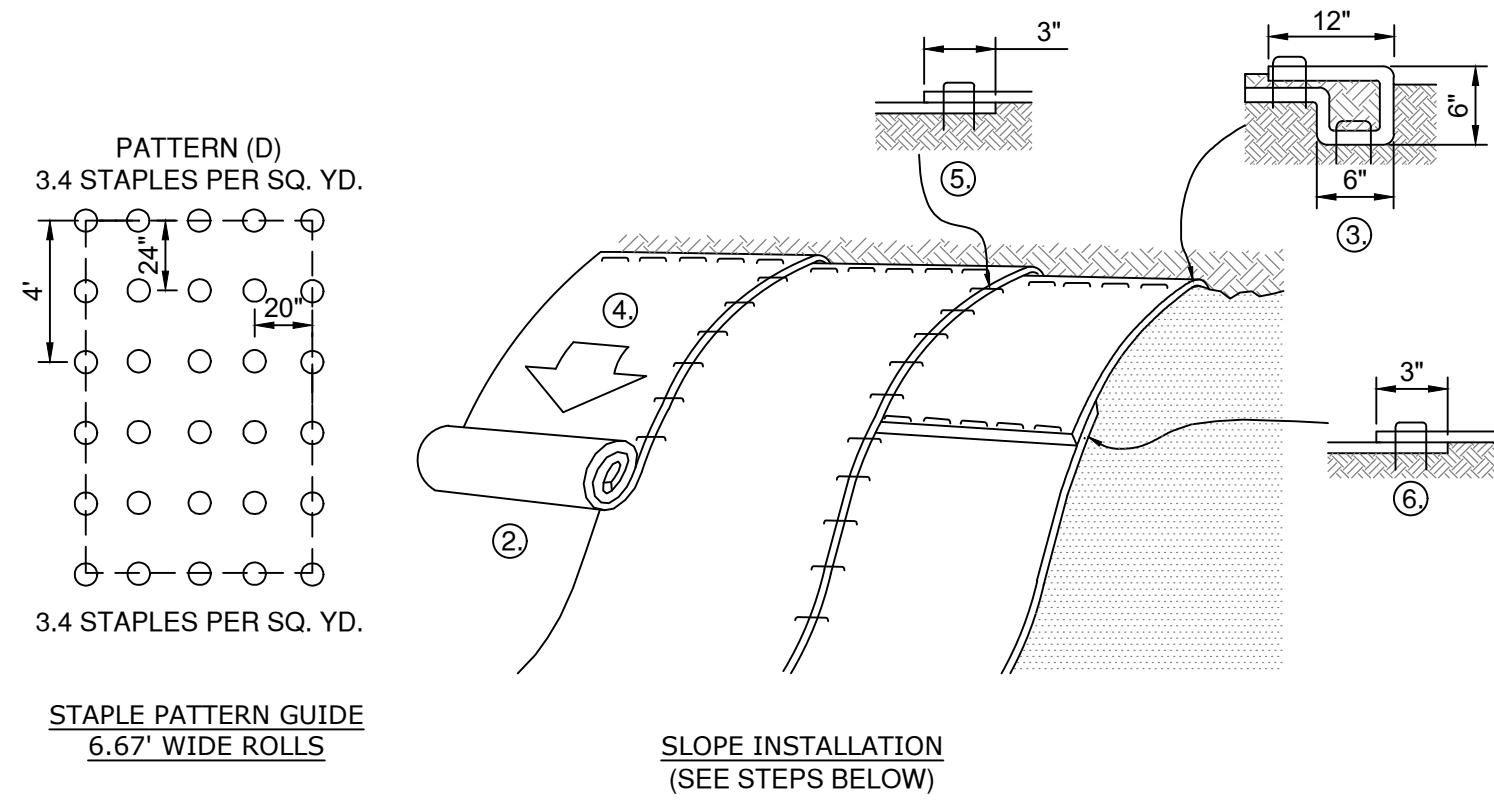

- NOTE:**
- THIS DETAIL REFERENCES PRODUCTS BY NORTH AMERICAN GREEN. EQUIVALENT PRODUCTS MAY BE USED AS APPROVED BY THE ENGINEER. EROSION CONTROL BLANKETS TO BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS AND INSTRUCTIONS.
1. EROSION CONTROL MATTING TO BE NORTH AMERICAN GREEN S75BN OR APPROVED EQUAL. INSTALL USING STAPLE PATTERN D.
 2. PREPARE SOIL BEFORE INSTALLING ROLLED EROSION CONTROL PRODUCTS (RECPs), INCLUDING ANY NECESSARY APPLICATION OF LIME, FERTILIZER, AND SEED (SEE DRAWING G-001).
 3. BEGIN AT THE TOP OF THE SLOPE BY ANCHORING THE RECPs IN A 6" DEEP X 6" WIDE TRENCH WITH APPROXIMATELY 12" OF RECPs EXTENDED BEYOND THE UP-SLOPE PORTION OF THE TRENCH. ANCHOR THE RECPs WITH A ROW OF STAPLES/STAKES APPROXIMATELY 12" APART IN THE BOTTOM OF THE TRENCH. BACKFILL AND COMPACT THE TRENCH AFTER STAPLING. APPLY SEED TO COMPACTED SOIL AND FOLD REMAINING 12" PORTION OF RECPs BACK OVER SEED AND COMPACTED SOIL. SECURE RECPs OVER COMPACTED SOIL WITH A ROW OF STAPLES/STAKES SPACED APPROXIMATELY 12" APART ACROSS THE WIDTH OF THE RECPs.
 4. ROLL THE RECPs DOWN THE SLOPE. RECPs WILL UNROLL WITH APPROPRIATE SIDE AGAINST THE SOIL SURFACE. ALL RECPs MUST BE SECURELY FASTENED TO SOIL SURFACE BY PLACING STAPLES/STAKES IN APPROPRIATE LOCATIONS AS SHOWN IN THE STAPLE PATTERN GUIDE. WHEN USING THE DOT SYSTEM, STAPLES/STAKES SHOULD BE PLACED THROUGH EACH OF THE COLORED DOTS CORRESPONDING TO THE APPROPRIATE STAPLE PATTERN.
 5. THE EDGES OF PARALLEL RECPs MUST BE STAPLED WITH AN APPROXIMATE 3" OVERLAP.
 6. CONSECUTIVE RECPs SPLICED DOWN THE SLOPE MUST BE PLACED END OVER END (SHINGLE STYLE) WITH AN APPROXIMATE 3" OVERLAP. STAPLE THROUGH OVERLAPPED AREA, APPROXIMATELY 12" APART ACROSS ENTIRE RECPs WIDTH.
 7. STAPLES LONGER THAN 6 INCHES SHALL NOT BE USED WITHIN THE LIMIT OF WASTE TO AVOID PENETRATION INTO THE LANDFILL CAP.

EROSION CONTROL BLANKET INSTALLATION
NOT TO SCALE


6

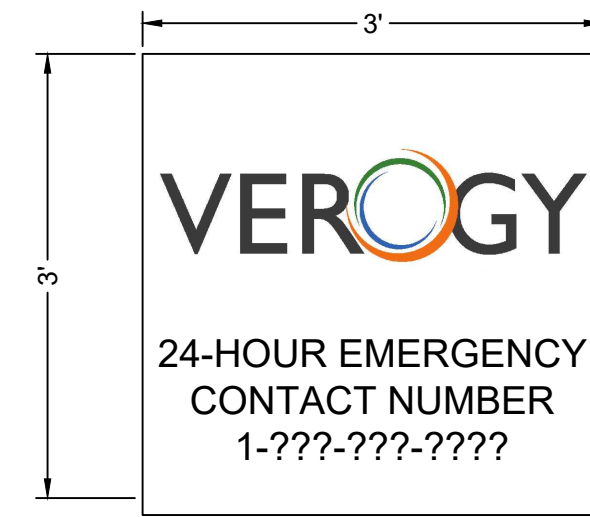

NOTE:
CONTACT NUMBER TO BE FINALIZED PRIOR TO CONSTRUCTION.

ACCESS SIGN DETAIL
NOT TO SCALE


7

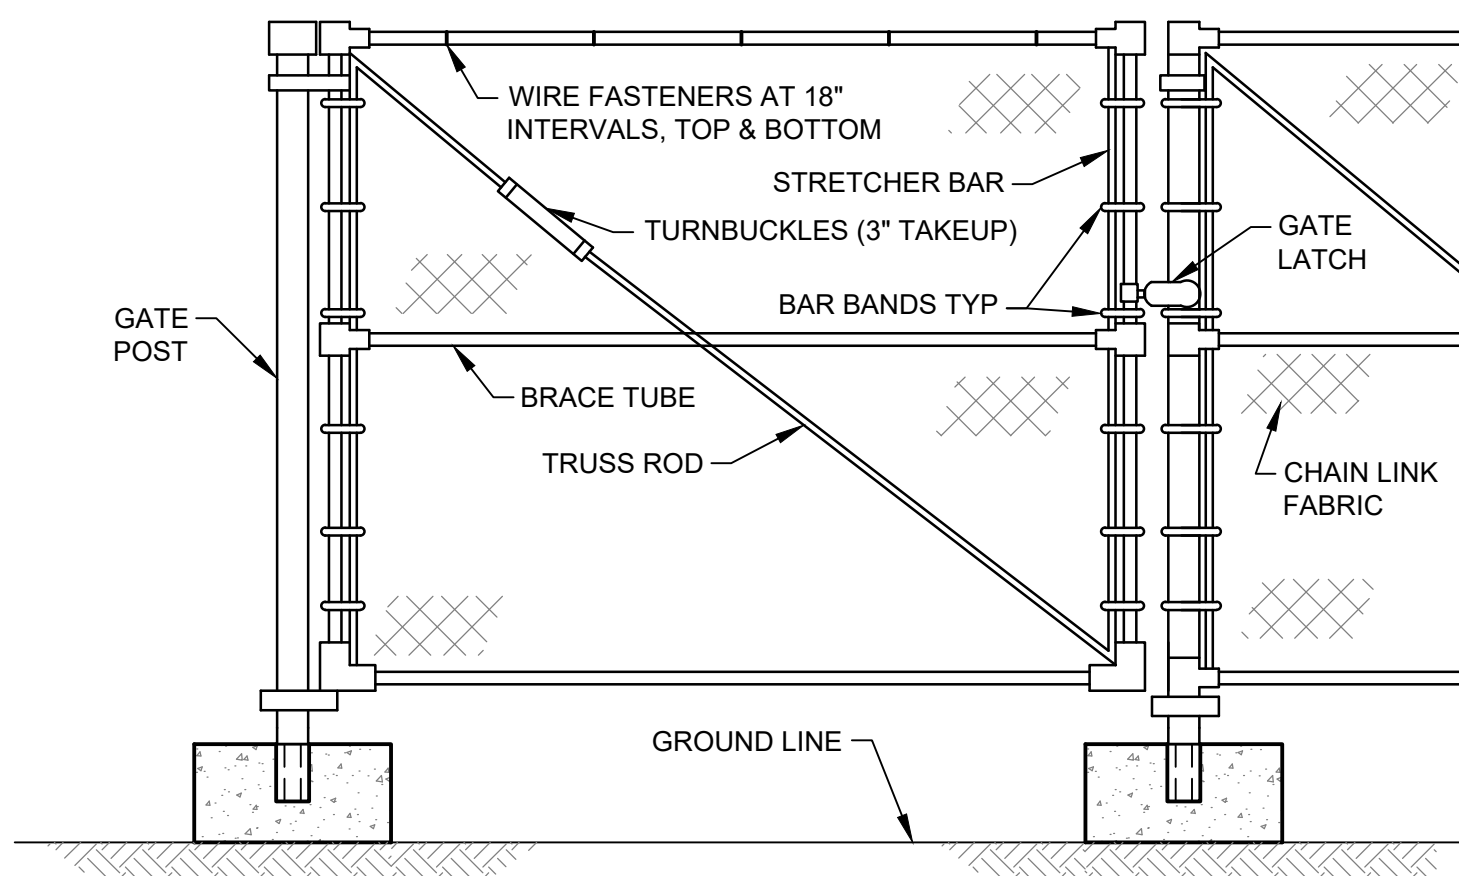


- NOTES:**
1. BALLAST AND FINAL FENCE DESIGN TO BE FINALIZED PRIOR TO CONSTRUCTION.

PEDESTRIAN CHAIN LINK FENCE GATE
NOT TO SCALE

BALLASTED FENCE DETAIL
NOT TO SCALE

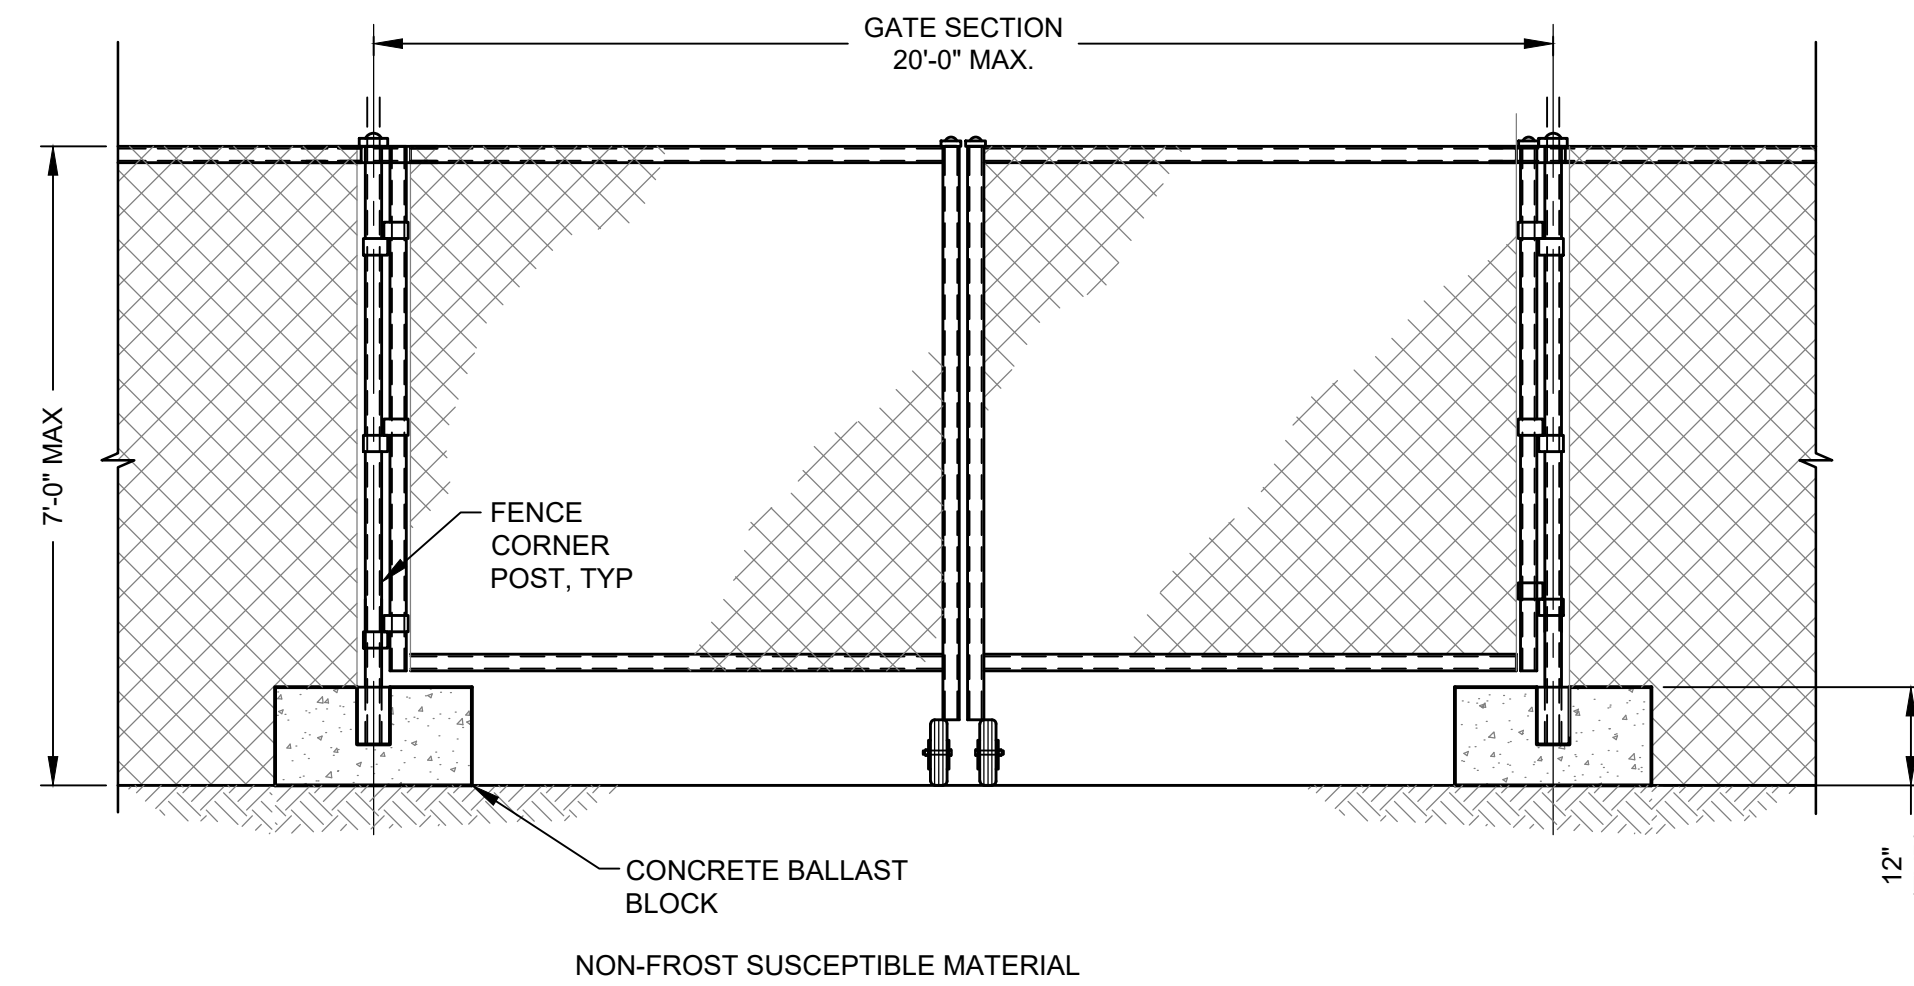

FENCE GATE DETAIL
NOT TO SCALE

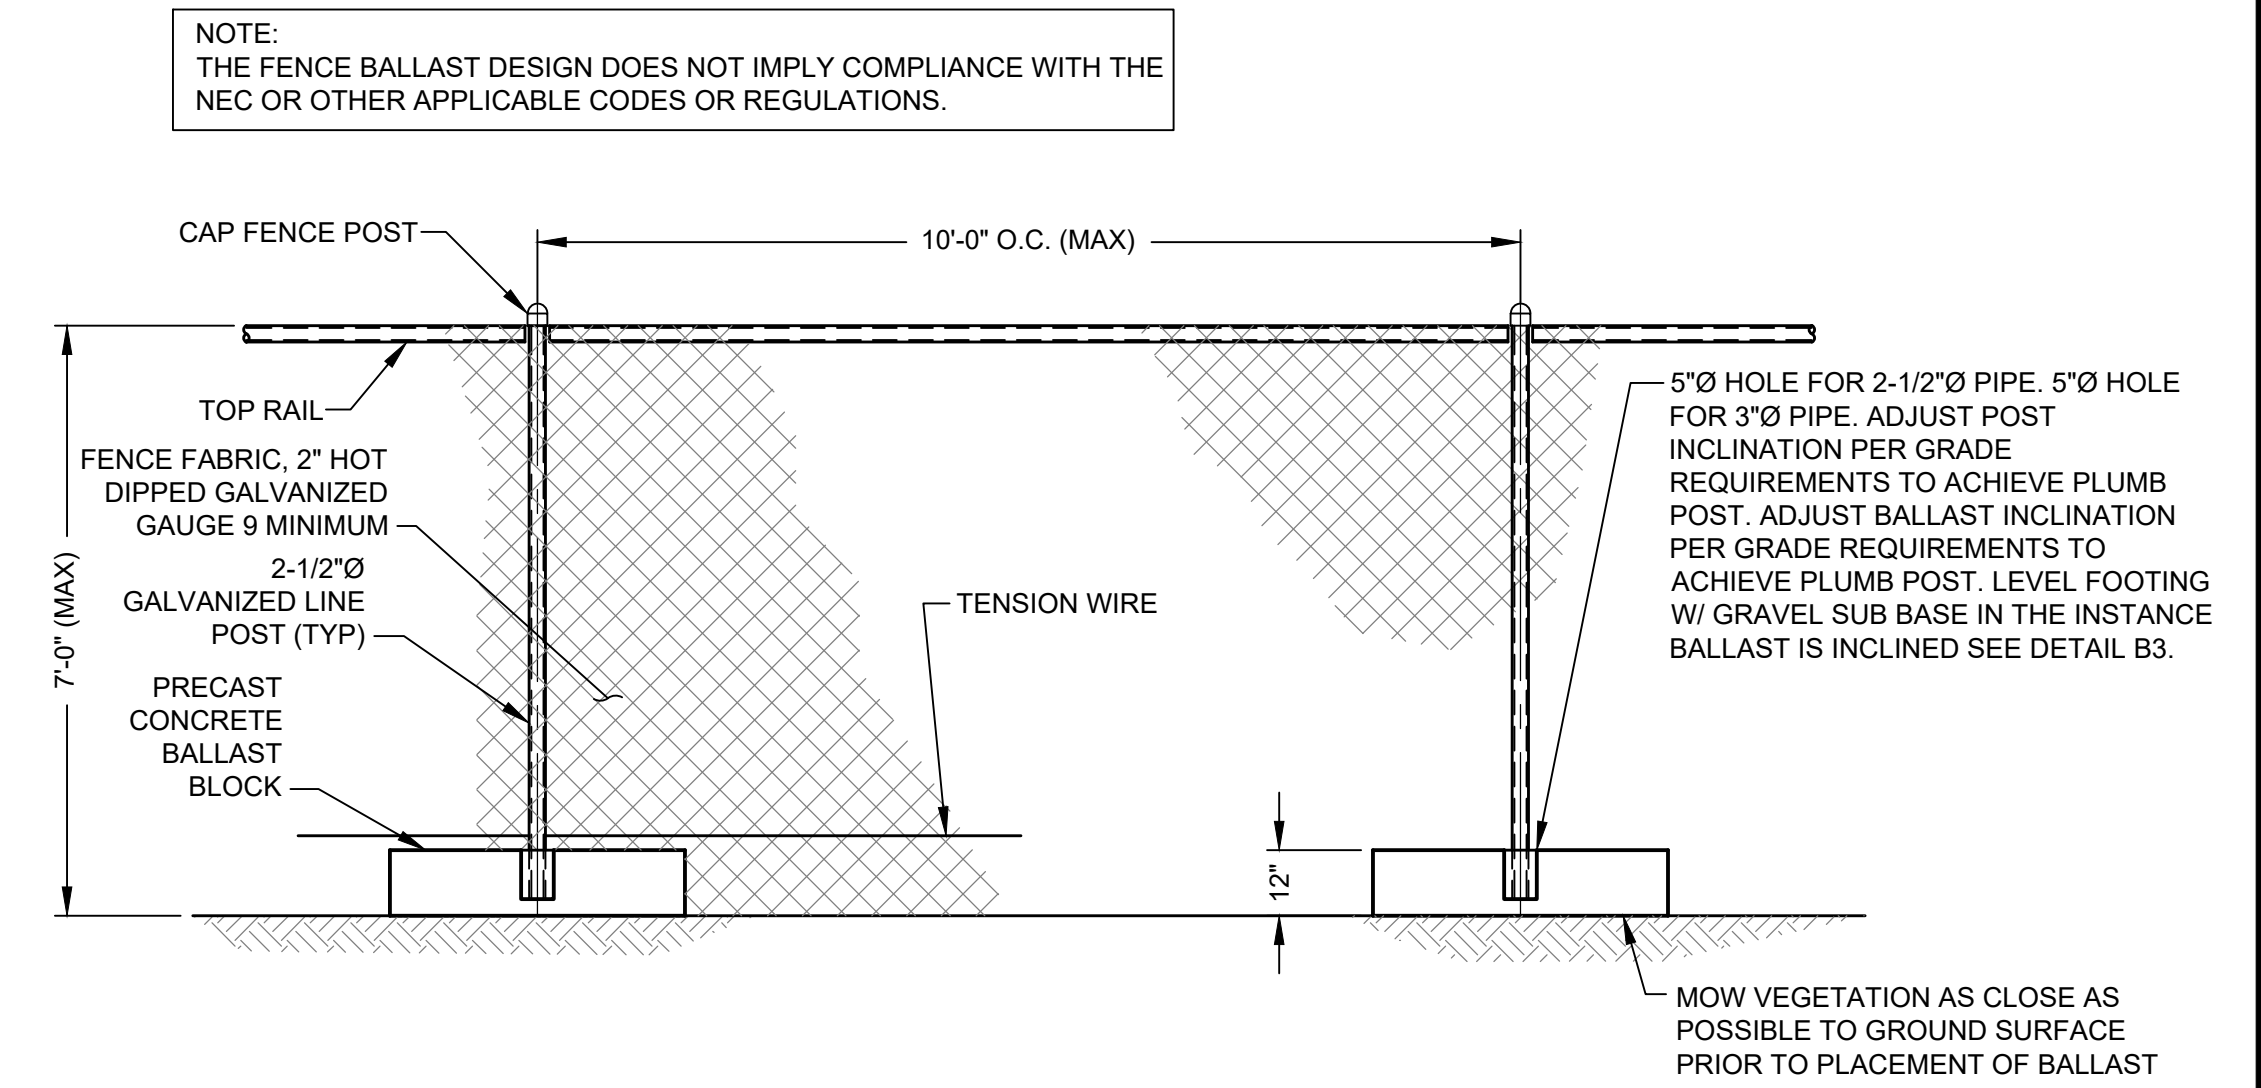

FENCE ELEVATION
NOT TO SCALE

NOTE:
THE FENCE BALLAST DESIGN DOES NOT IMPLY COMPLIANCE WITH THE NEC OR OTHER APPLICABLE CODES OR REGULATIONS.

8

REVISION	DATE	ISSUE / REVISION DESCRIPTION
5	2/09/2023	REVISED PER CITY COMMENTS
4	1/19/2023	ISSUED FOR PERMITTING / NOT FOR CONSTRUCTION
3	9/10/2021	RESPONSE TO RIBEM COMMENTS
2	8/20/2021	RESPONSE TO RIBEM COMMENTS
1	6/28/2021	ADDRESSED COMMENTS
0	5/27/2021	ISSUED FOR PERMITTING / NOT FOR CONSTRUCTION

PROJECT: 998.40 KW DC GROUND-MOUNT SOLAR PV DEVELOPMENT
275 KNIGHT STREET
WARWICK, RHODE ISLAND

TITLE: CONSTRUCTION, EROSION, AND SEDIMENTATION CONTROL DETAILS 1

CLIENT: VCP, LLC
150 TRUMBULL ST.
HARTFORD, CT 06103

VEROGY

SEAL: ANDREW P. VARDAKIS
No. 12219
REGISTERED PROFESSIONAL ENGINEER (CIVIL)



DESIGNED BY: CR
DRAWN BY: BEG

CHECKED BY: GAA
SCALE: AS SHOWN

PROJECT NUMBER: 3652200299

DRAWING NUMBER: C-502

SHEET NUMBER: 5 OF 5

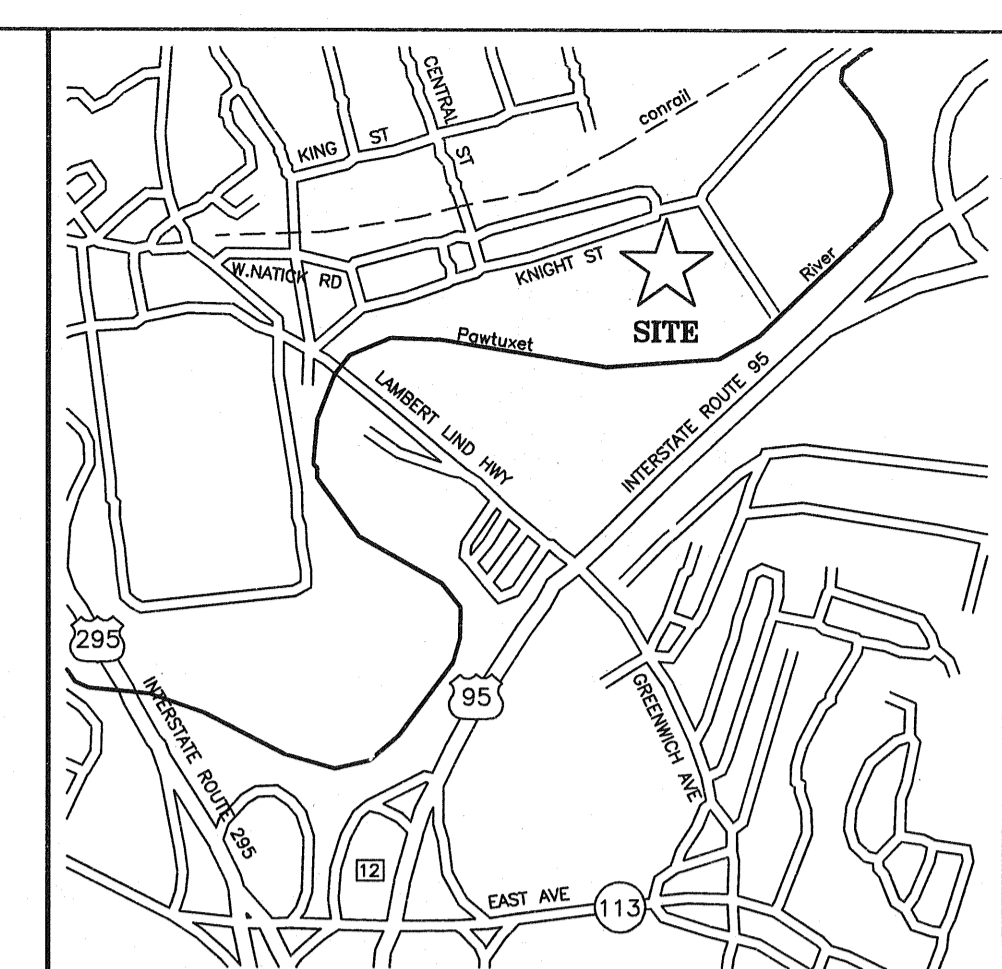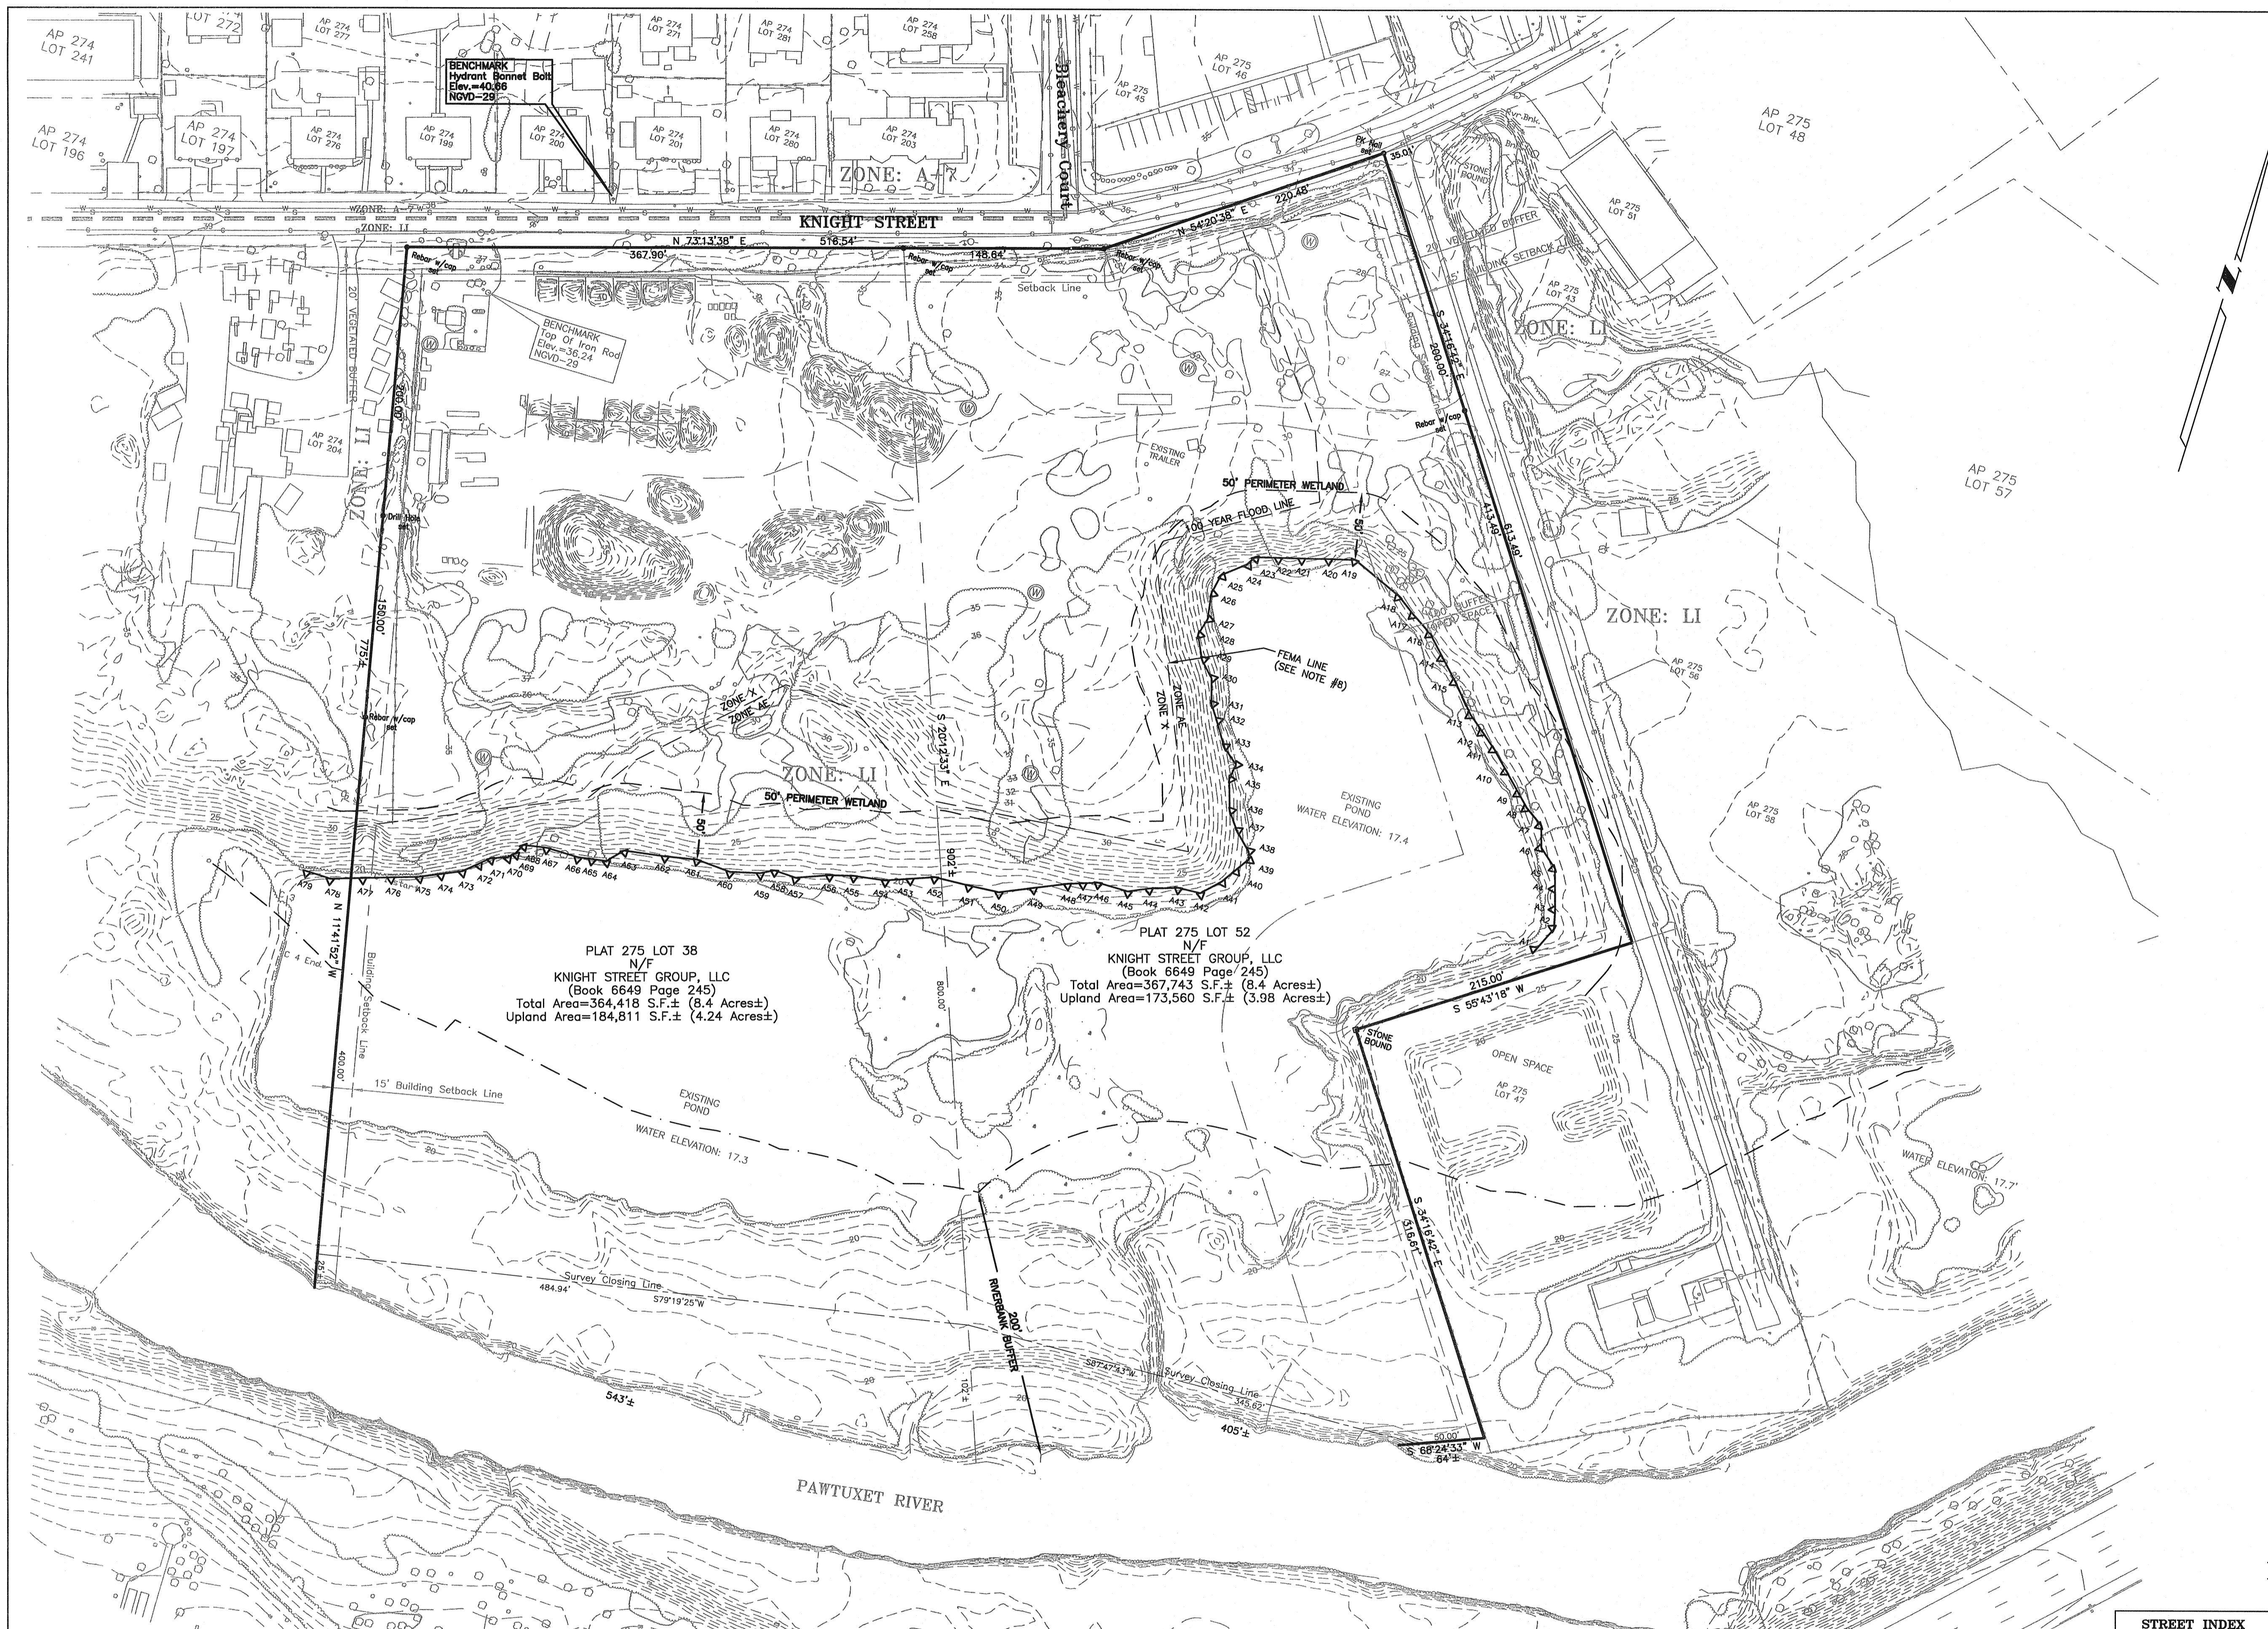

LOCATION MAP Scale: 1" = 1,200'±

DISTRICT DIMENSIONAL REGULATIONS

District	LI
Use	Non-Residential
Min. Lot Area	6,000 Sq. Ft.
Min. Frontage	60 feet
Min. Lot Width	60 feet
Min. Front Yard Depth	25 feet
Min. Cor. Side Yard Depth	25 feet
Min. Side Yard Depth	15 feet **
Min. Rear Yard Depth	20 feet **
Max. Structure Height	45 feet
Min. Landscaped Open Space	10%

** A commercial building or use shall be setback a minimum of 40 feet from an Open Space district parcel of 5,000 square feet or more.

An industrial building or use shall be setback a minimum of 40 feet from an abutting commercial district and 100 feet from an Open Space district parcel of 5,000 square feet or more.

A 20 foot wide landscaped buffer shall be provided along any property line that abuts a residence district, PDR overlay district, residential PUD overlay district, or an open space district where such lot contains at least 5,000 square feet including any coastal or freshwater wetlands.

Parking requirements for wholesale business, storage space and warehouses: 1 per 500 sq.ft. of gross floor area.

- NOTES:
- Reference is made to the following deed:
 - A Warranty Deed from Towanda Associates, Inc. granted to Knight Street Group, LLC recorded August 16, 2007 in the City of Warwick Land Evidence Book 6649 Page 245.
 - Reference is made to the following plan:
 - Existing Conditions Plan Figure 2 Site Investigation Report Former Pontiac Mills Property Plat 275 Lots 38 & 52 Warwick, Rhode Island Date 1-07-2008 Scale 1"=125' EA Engineering, Warwick, RI.
 - The planimetric features and topography was compiled from the plan referenced in Note #2A. The bearings and north arrow orientation depicted hereon are based upon NAD-83 per plan reference #2A. The topographic features depicted hereon are based upon NGVD-29 per plan reference #2A.
 - The utility information depicted hereon was compiled from information provided by the City of Warwick Department of Public Works and the City of Warwick Water Department July, 2008.
 - The gas line location depicted hereon was compiled from information provided by National Grid.
 - The wetlands depicted hereon were field surveyed located July 30, 2008 by Cherenzia & Associates, Ltd.
 - Flood Zone information from FIRN Flood Insurance Rate Map City of Warwick, Rhode Island Kent County Panel 2 Of 9 Community-Panel Number 445409 0002 D Map Revised: April 16, 1991.
 - Flood Zone area was revised for locus parcel per: Federal Emergency Management Agency Letter Of Map Revision Floodway Determination Document (Removal) Date: March 20, 2007 Case No.: 07-01-0070A (100-year floodplain at elevation 29)

PLAT 275 LOT 38
N/F
KNIGHT STREET GROUP, LLC
(Book 6649 Page 245)
Total Area=364,418 S.F.± (8.4 Acres±)
Upland Area=184,811 S.F.± (4.24 Acres±)

PLAT 275 LOT 52
N/F
KNIGHT STREET GROUP, LLC
(Book 6649 Page 245)
Total Area=367,743 S.F.± (8.4 Acres±)
Upland Area=173,560 S.F.± (3.98 Acres±)


LEGEND

	EXISTING CONTOURS
	UTILITY POLE
	FENCE LINE
	SANITARY SEWER LINE
	STORM SEWER LINE
	GAS LINE
	WETLAND FLAG

This survey and plan conform to the following standards as adopted by the Rhode Island Board of Registration for Professional Surveyors.

Horizontal Classification: Class: I
Vertical Classification: Topography & Benchmark: Class: Compiled (See Note #3)

By: *Nathan D. Lauder*
Registered Professional Land Surveyor

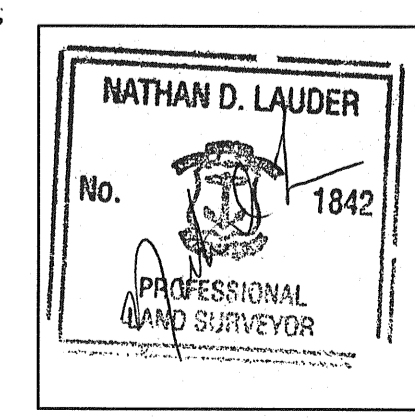

PLAN REVISIONS			
DATE	DESCRIPTION	DWN BY	CHK BY

Civil Engineers
Land Surveyors
Land Use Planners
Environmental Consultants

CHERENZIA & ASSOCIATES, LTD.
Raymond F. Cherenzia, P.E., L.S.

Office Location
99 Mechanic Street
Pawtucket, RI 02860
Tel (800) 829-8500
Fax (860) 899-8000

Mailing Address
P.O. Box 619
Westerly, RI 02891
Web Site: www.Cherenzia.com

BOUNDARY & TOPOGRAPHIC SURVEY

PREPARED FOR
KNIGHT STREET GROUP, LLC
PLAT 275 LOTS 38 & 52
KNIGHT STREET
WARWICK, RHODE ISLAND

SCALE: 1"=60' DRAWN BY: TWS
MARCH 27, 2009 CHECK BY: NDL

SHEET: 1 OF 1 JOB NO.: 208064